




**PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640**

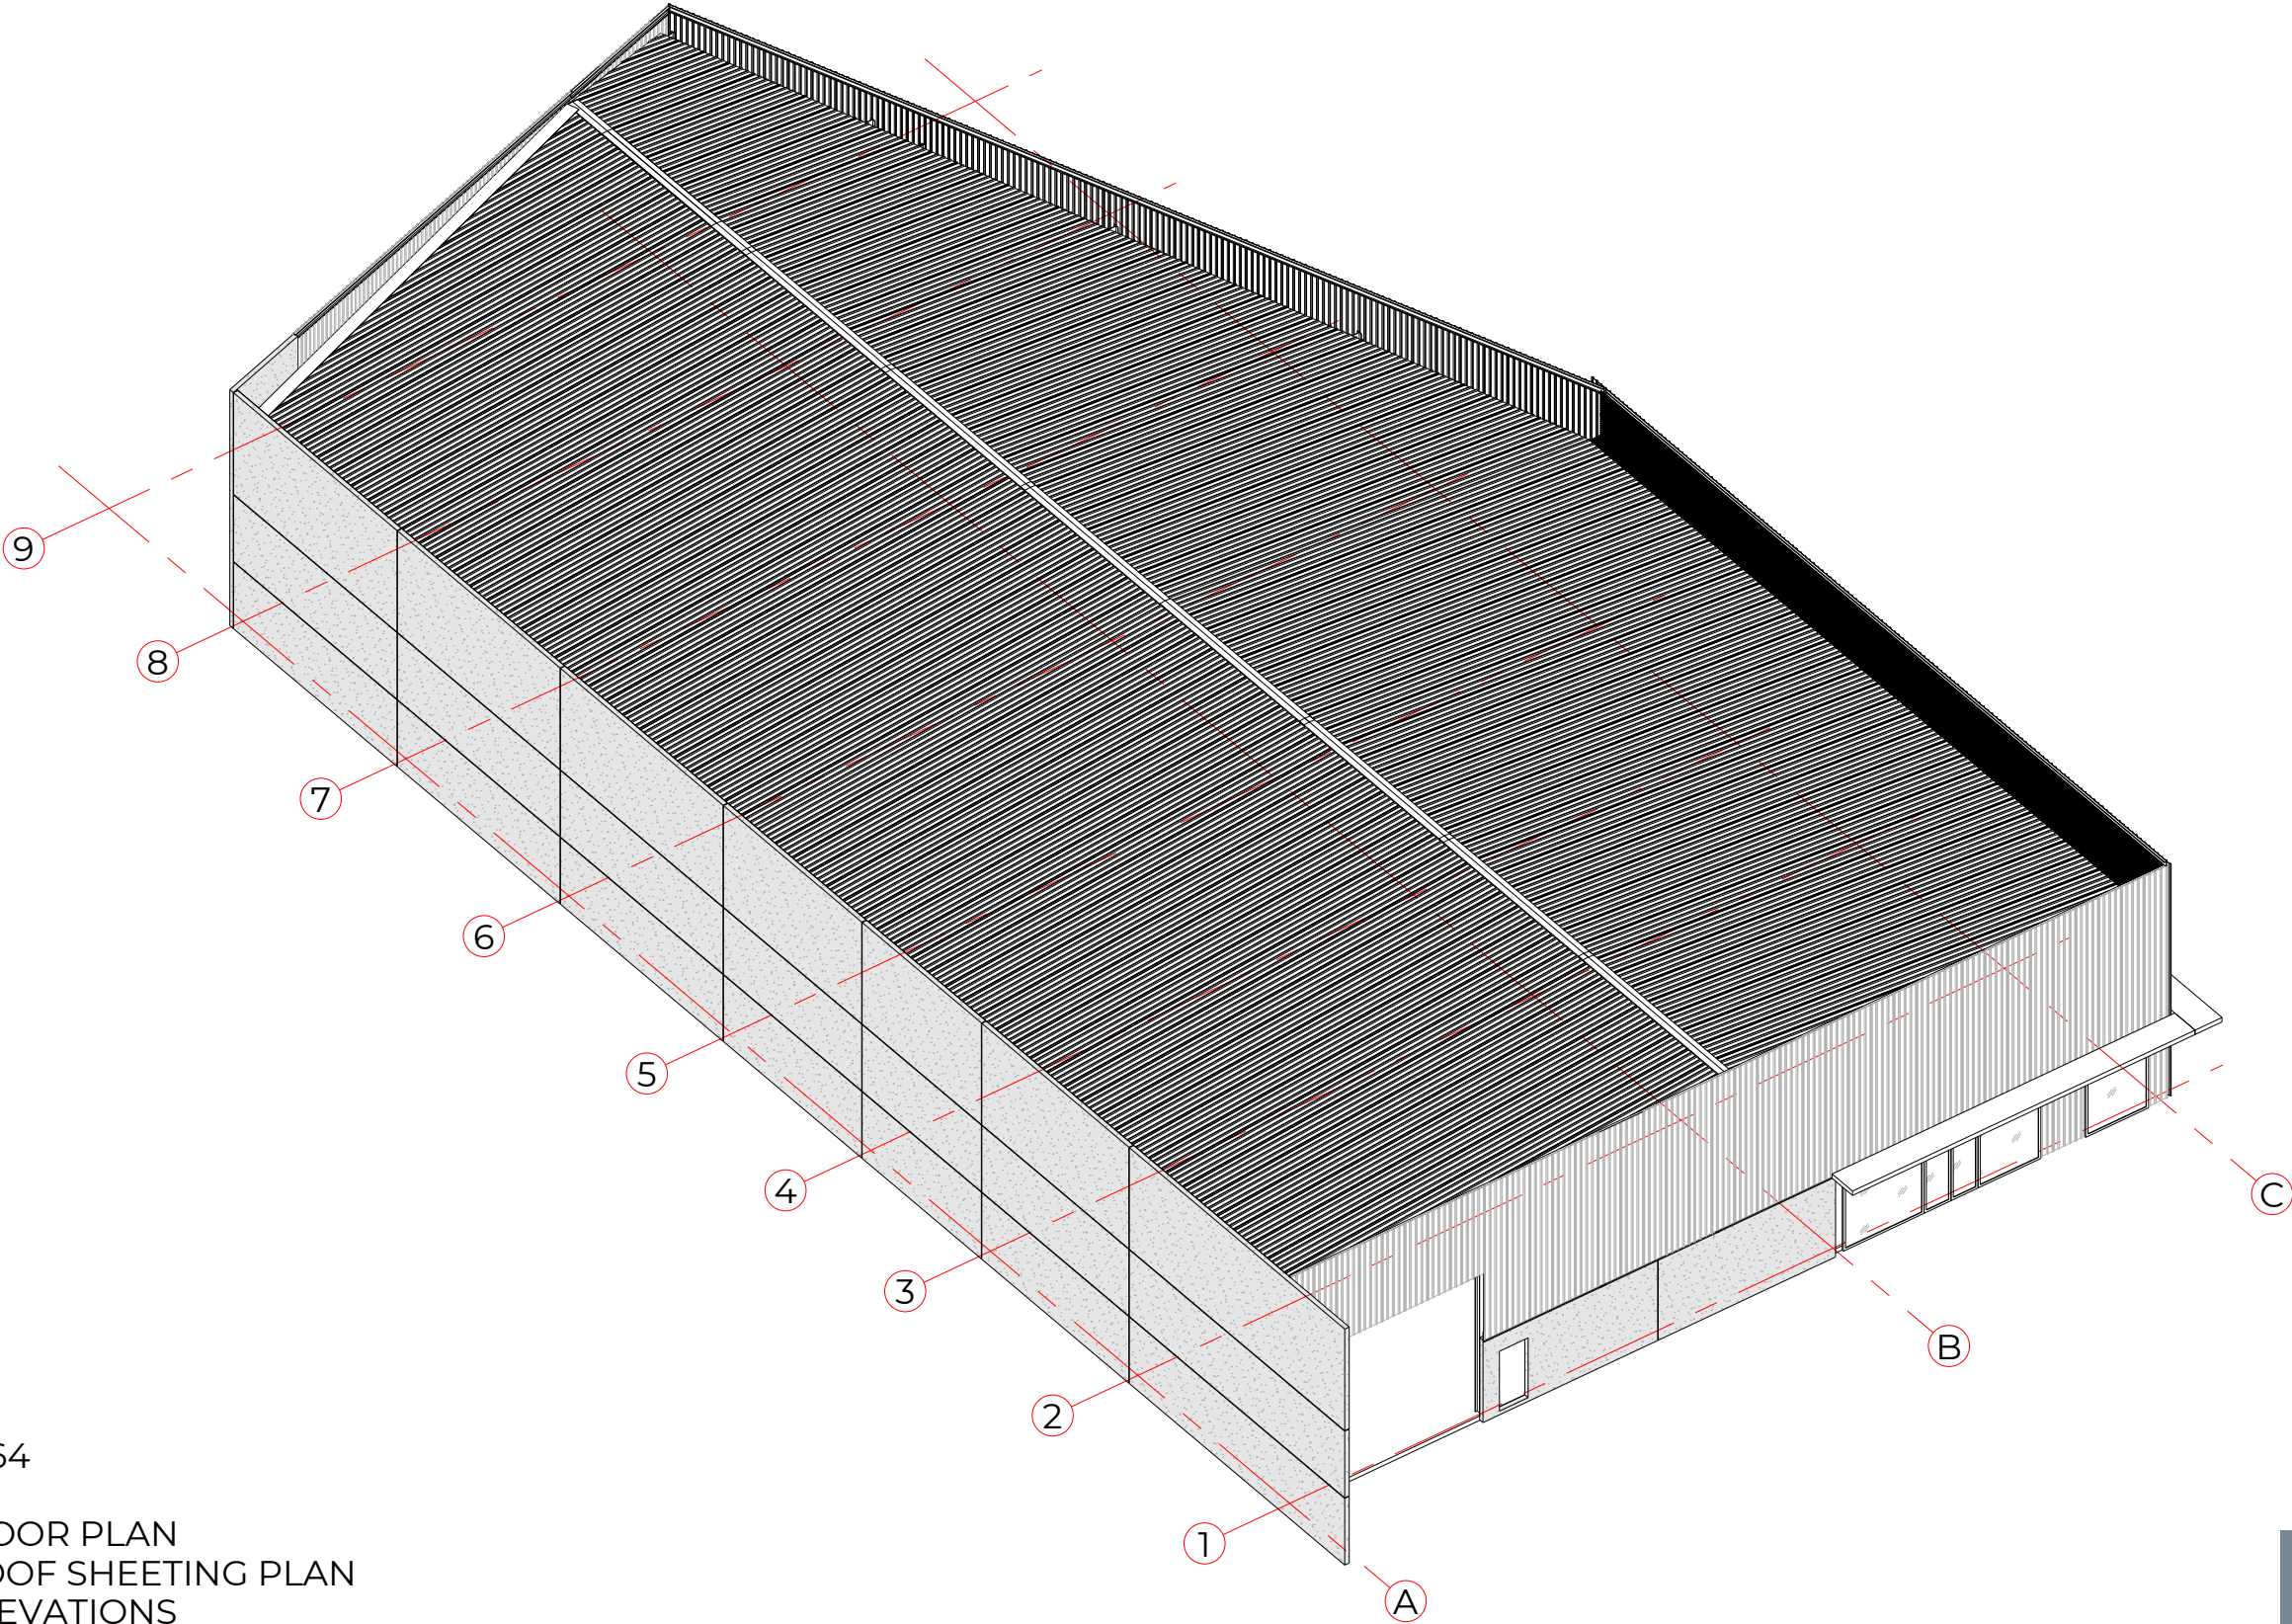

JOB: 21064
A1.01 - FLOOR PLAN
A1.02 - ROOF SHEETING PLAN
A2.01 - ELEVATIONS
A3.01 - SECTIONS & DETAILS

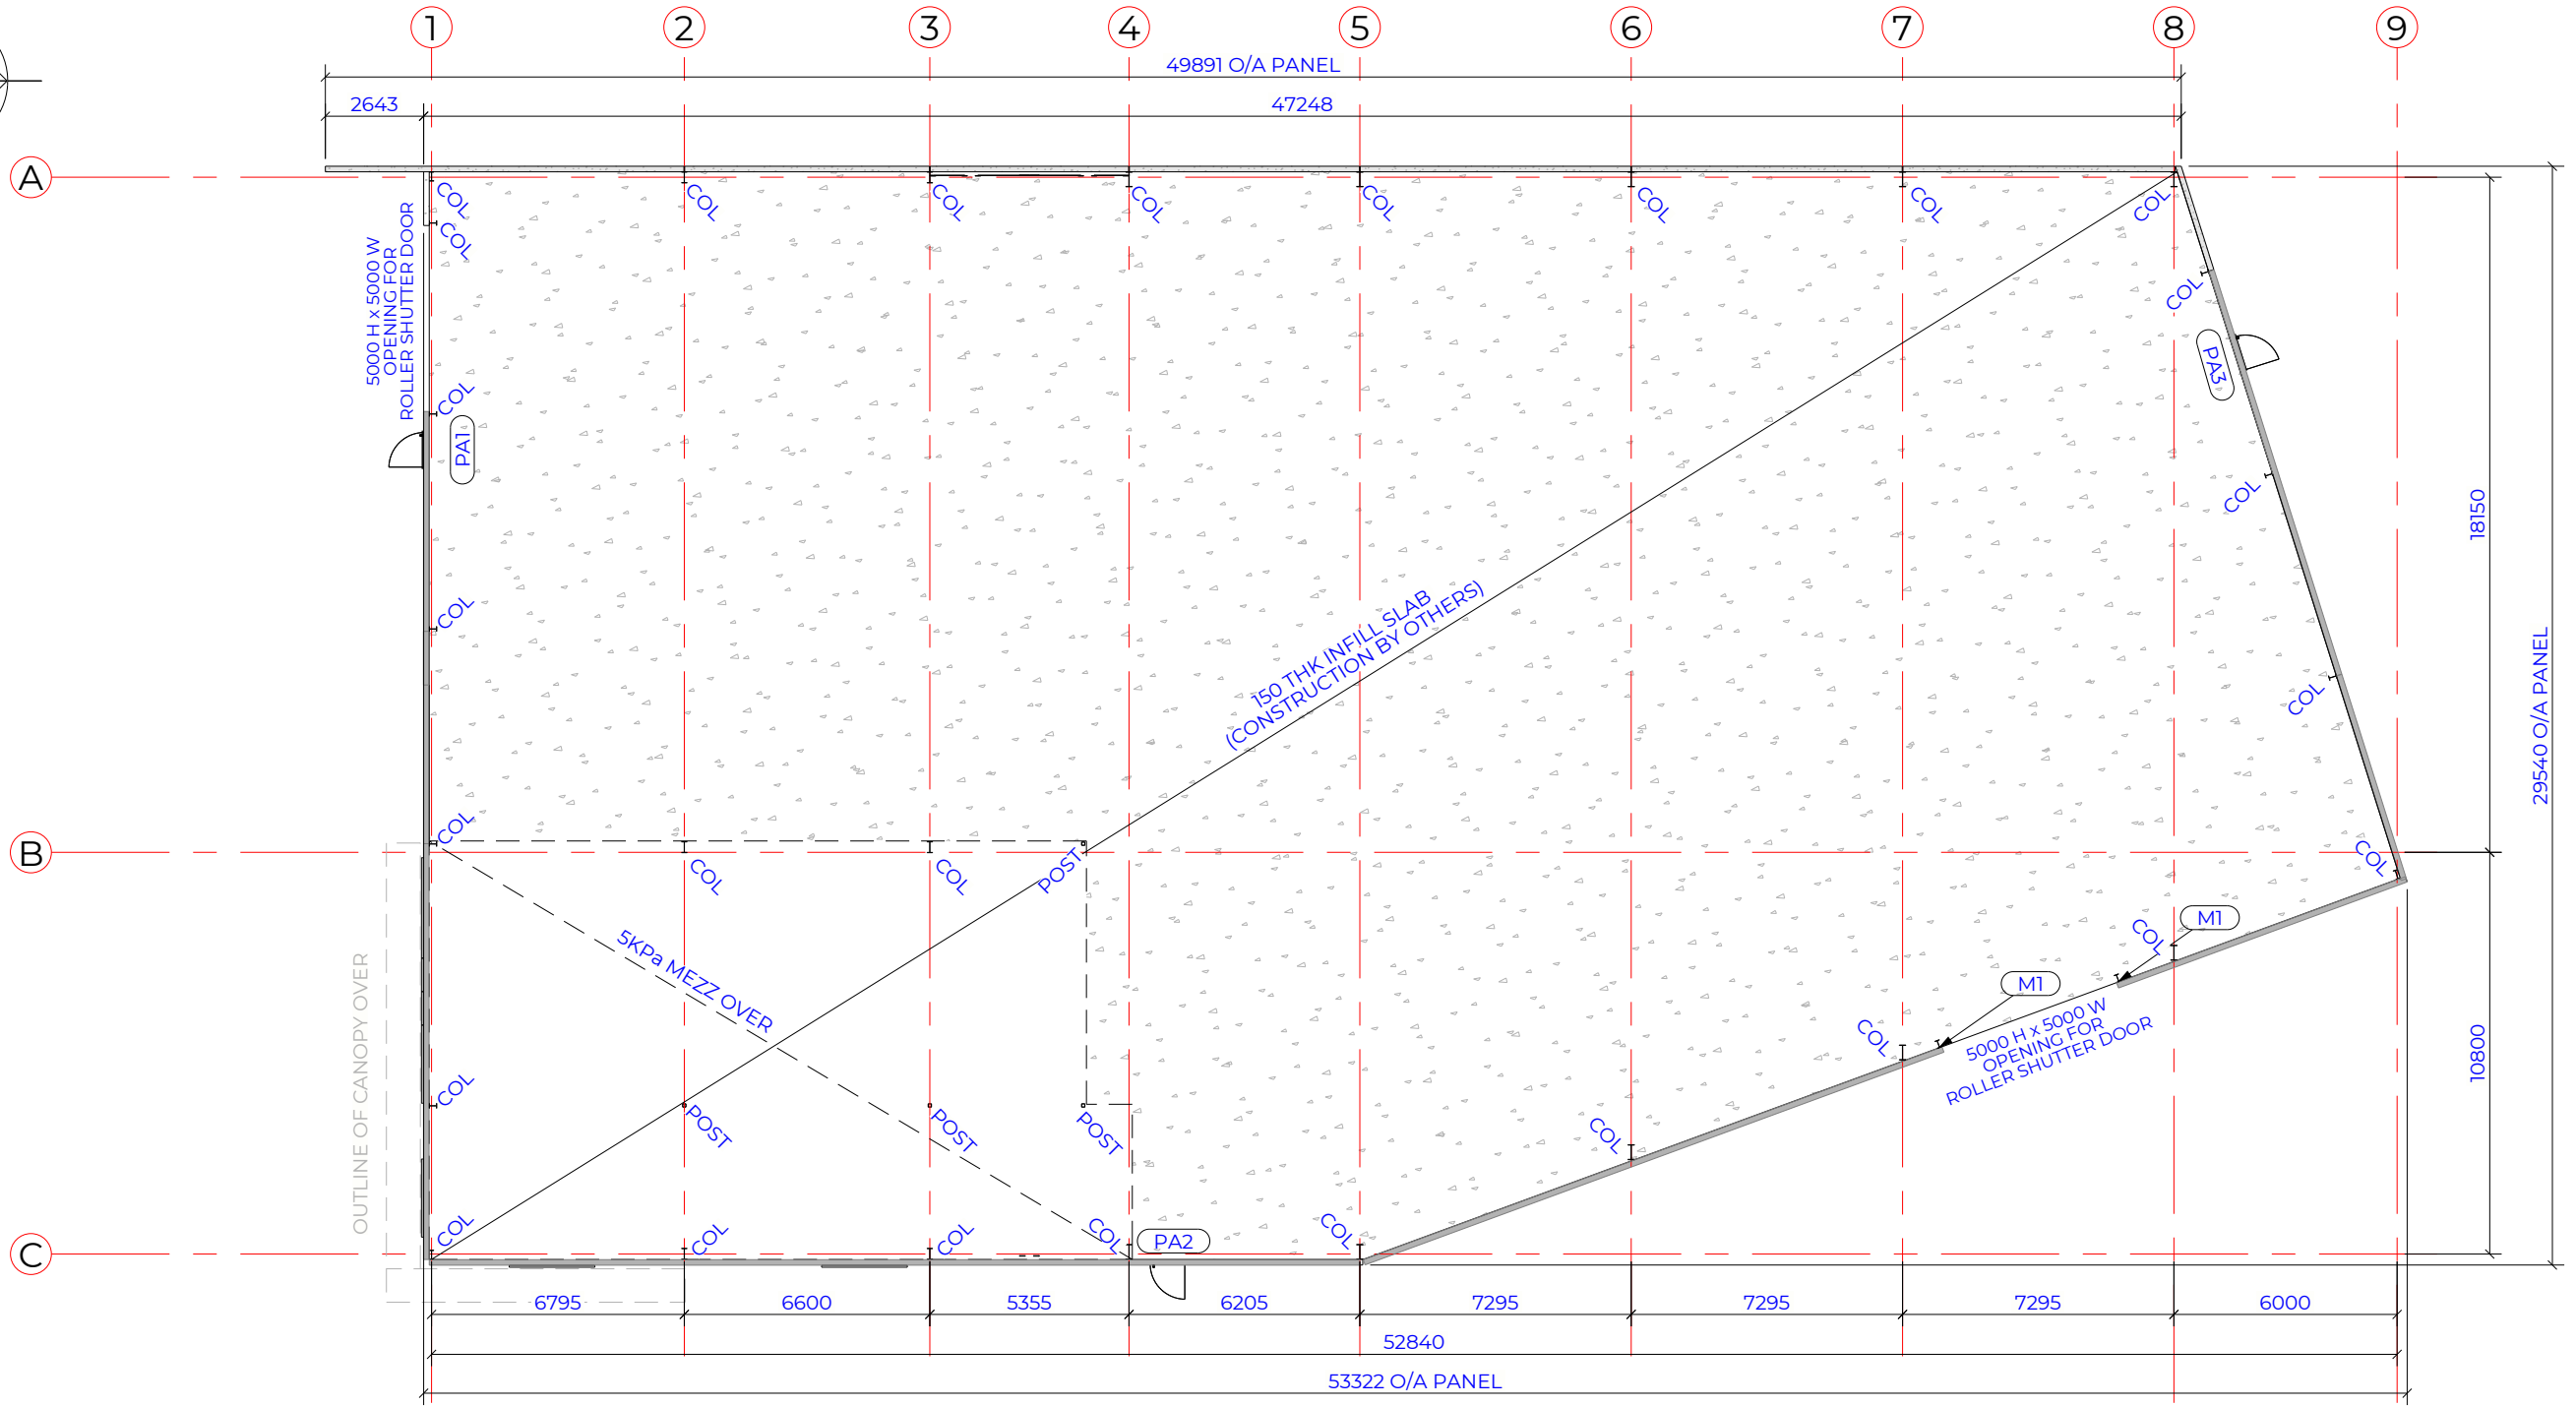



NOTE:
MEZZANINE FLOOR RATED AT 5kpa SWL (SIGNAGE BY OTHERS)
HANDRAIL AND STAIRWAY (BY OTHERS) TO MEET BCA PART D
& AS 1428.1-2009

DOOR SCHEDULE			
ITEM	SIZE	QTY	COMMENTS
PA1	920 w x 2040 h	1	920x2040 HD PA DOOR CBOND (TBC) DUTY: HEAVY DUTY
PA2	920 w x 2040 h	1	920x2040 HD PA DOOR CBOND (TBC) DUTY: HEAVY DUTY
PA3	920 w x 2040 h	1	920x2040 HD PA DOOR CBOND (TBC) DUTY: HEAVY DUTY

PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

FLOOR PLAN

JOB 21064



SHEET A1.01

REV A

THESE DRAWINGS ARE TO SHOW THE DESIGN
INTENT OF THE BUILD. FOR ALL STRUCTURAL
ELEMENTS REFER TO THE ENGINEERING
DRAWINGS SUPPLIED BY CSB

REV	DESCRIPTION	DATE	DRAWN
A	PRELIMINARY	05/05/2025	AK



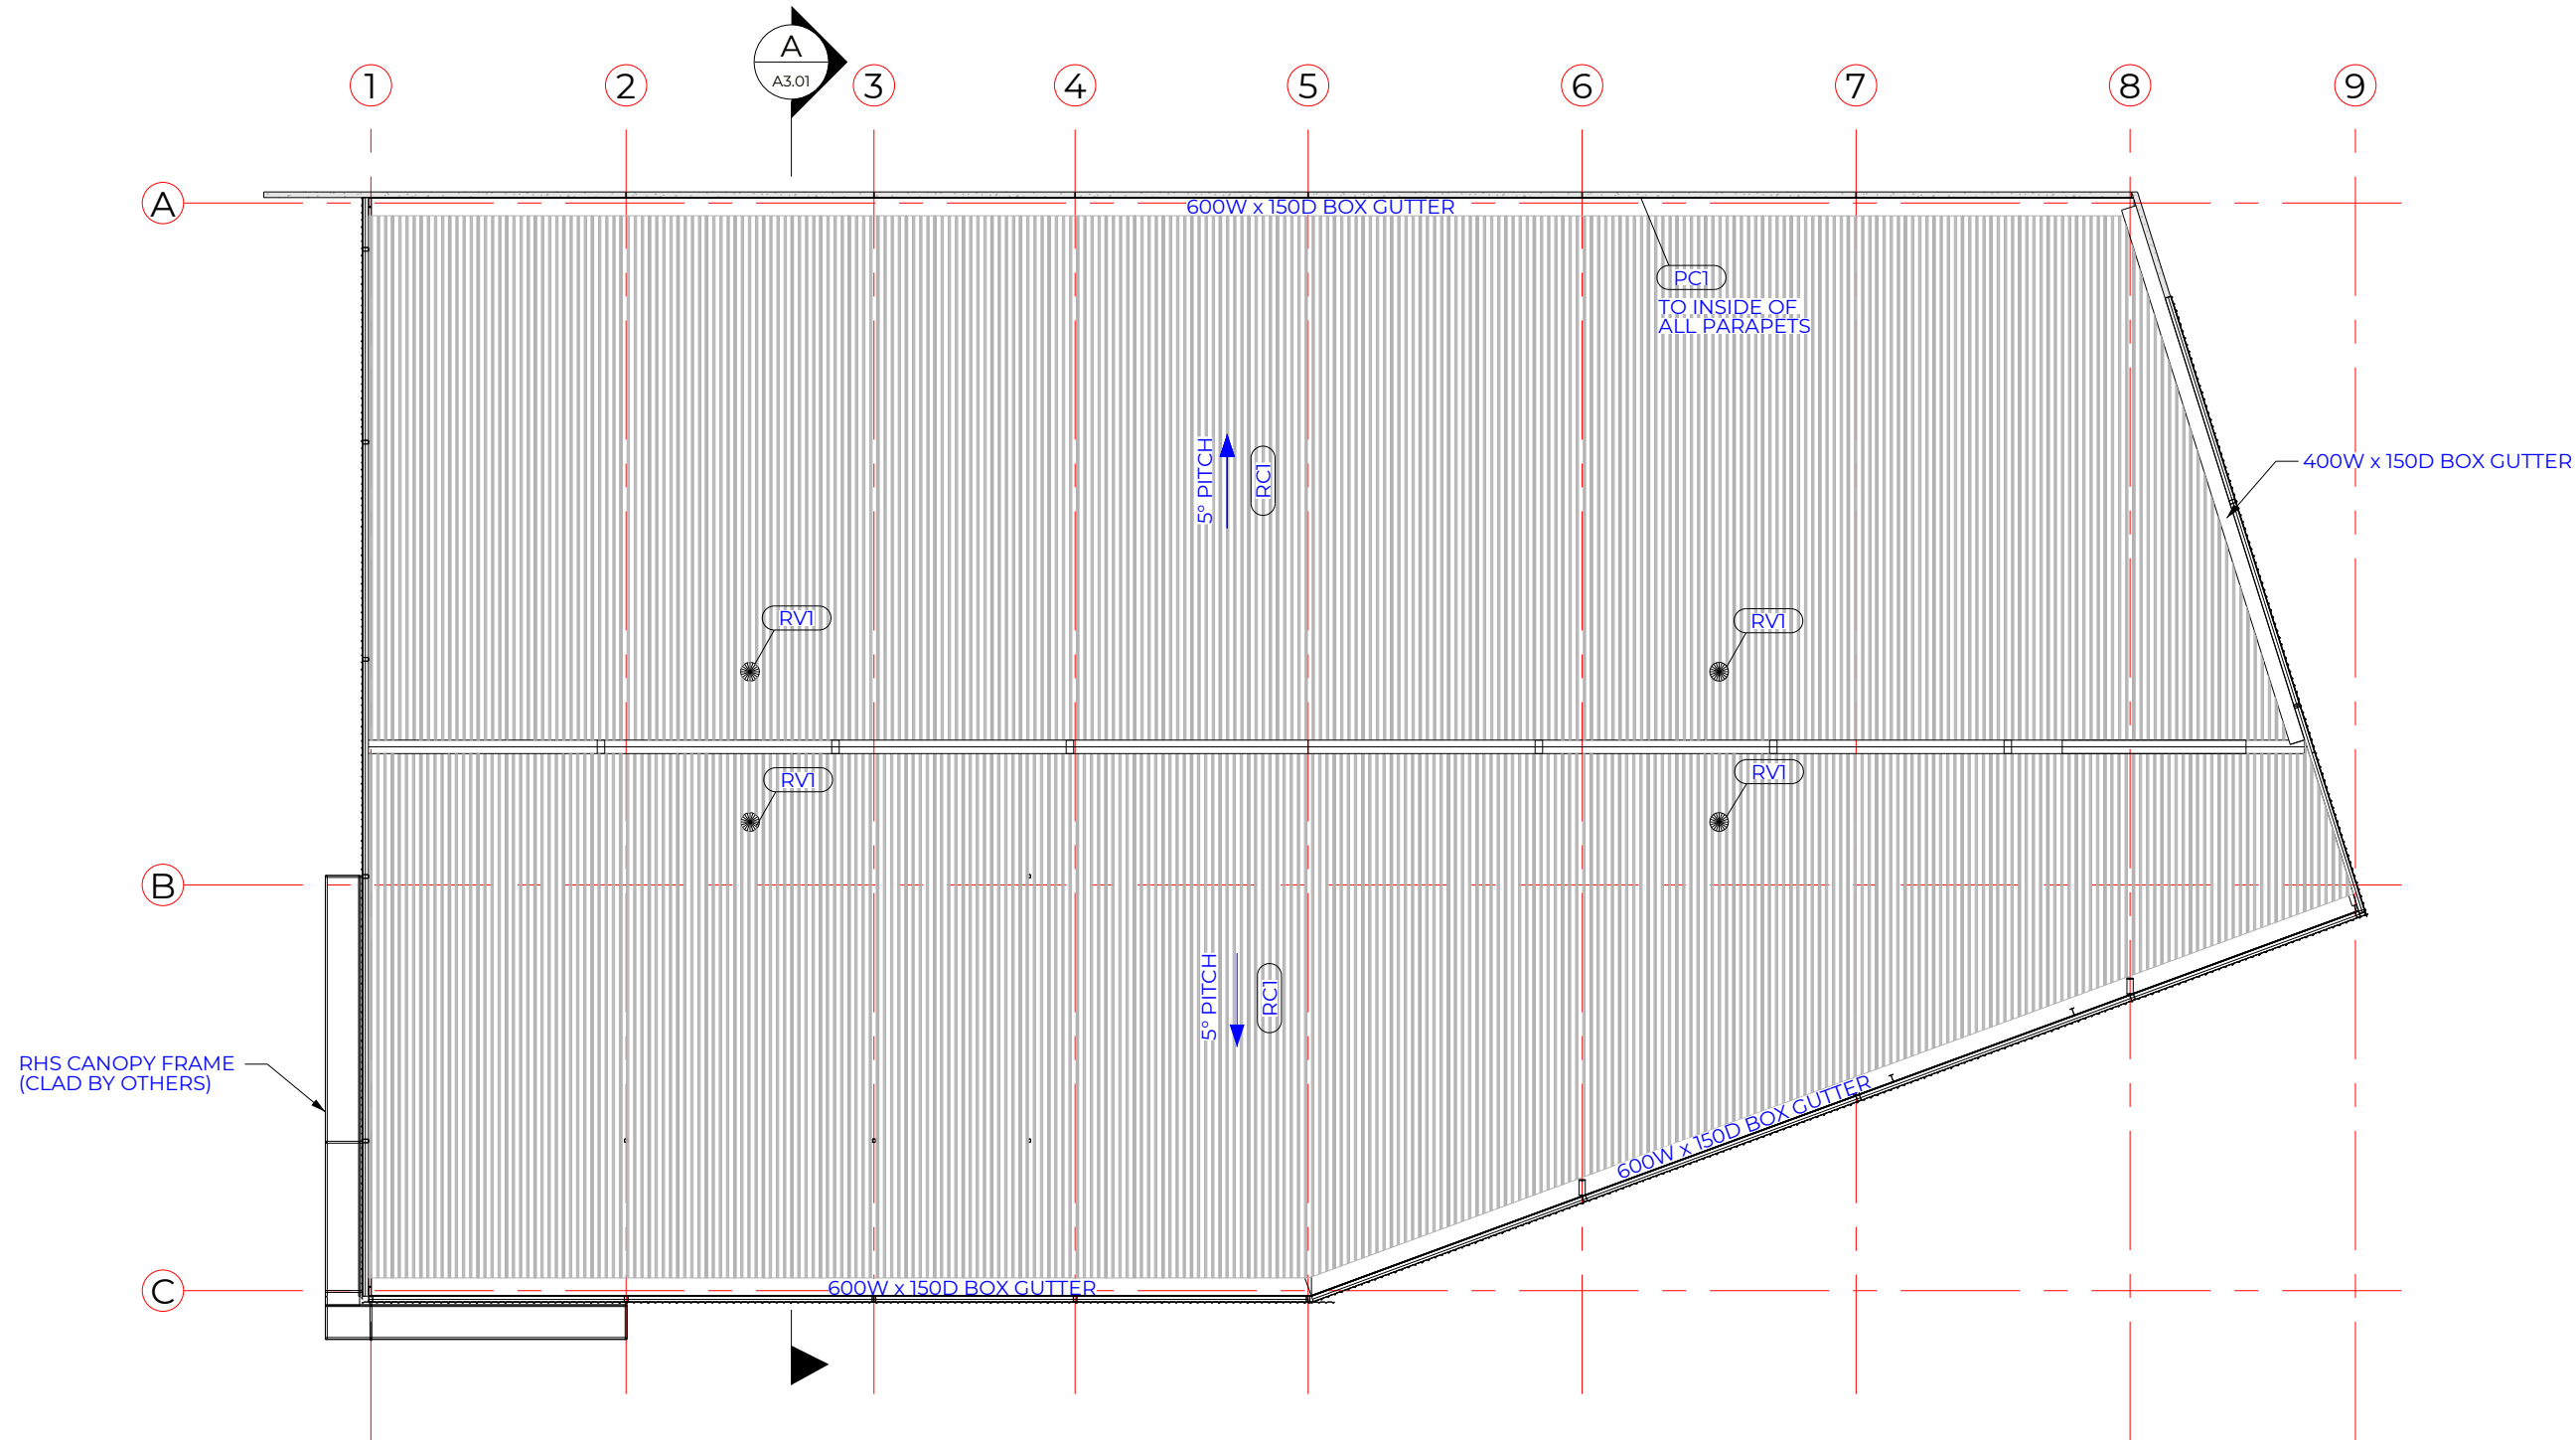

SOLAR NOTE:
ALLOWANCE MADE FOR 15kg PER SQM

NOTE:
55mm BLANKET & SAFETY MESH
INCLUDED IN MAIN ROOF ONLY

CLADDING SCHEDULE			
ITEM	NAME	PROFILE	FINISH
RF1	V-RIDGE		C/BOND TBC
RV1	500mm WHIRLY BIRD		C/BOND TBC
TF1	TOE FLASHING		MONUMENT
RC1	ROOF CLADDING	0.47-TCT-5RIB	C/BOND TBC
GC1	BOX GUTTER CLADDING	0.47-TCT-CORRY	ZINC
PC1	PARAPET CLADDING	0.47-TCT-CORRY	ZINC
WC1	WALL CLADDING	0.47-TCT-5RIB	MONUMENT

PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

ROOF SHEETING PLAN

JOB 21064

SHEET A1.02


REV A

THESE DRAWINGS ARE TO SHOW THE DESIGN
INTENT OF THE BUILD. FOR ALL STRUCTURAL
ELEMENTS REFER TO THE ENGINEERING
DRAWINGS SUPPLIED BY CSB


REV	DESCRIPTION	DATE	DRAWN
A	PRELIMINARY	05/05/2025	AK

SIZE A3 SCALE 1:200 PAGE 3 OF 5




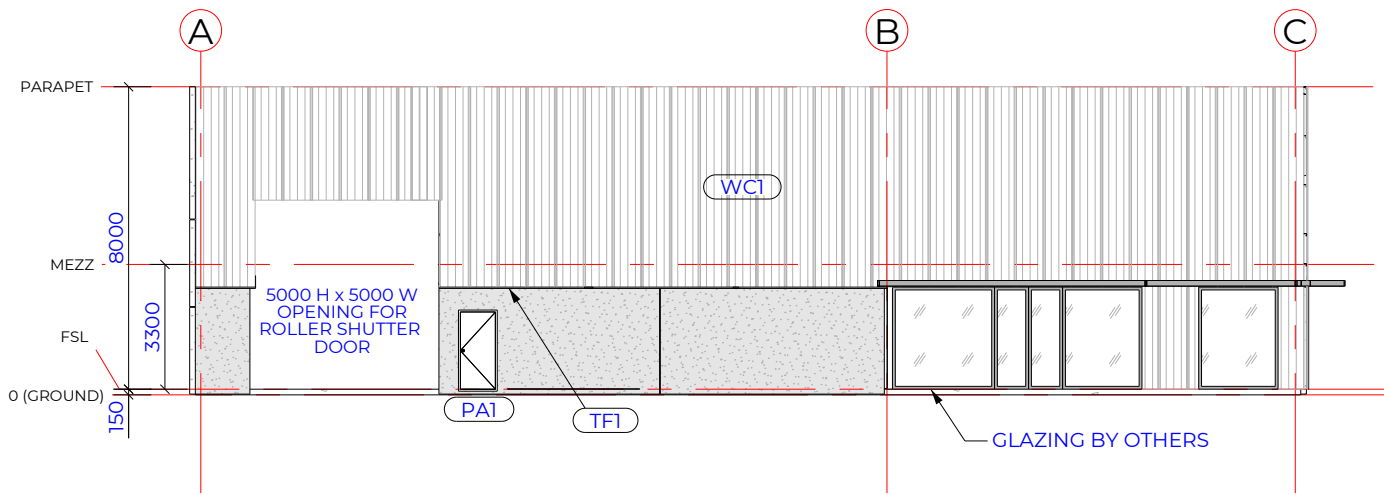


SOUTH ELEVATION

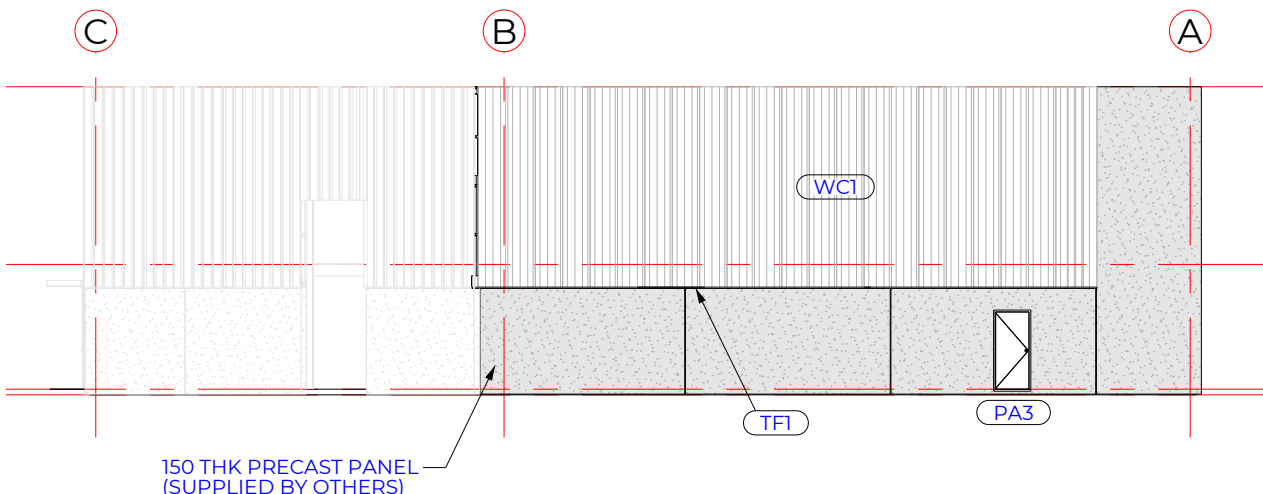

NORTH ELEVATION

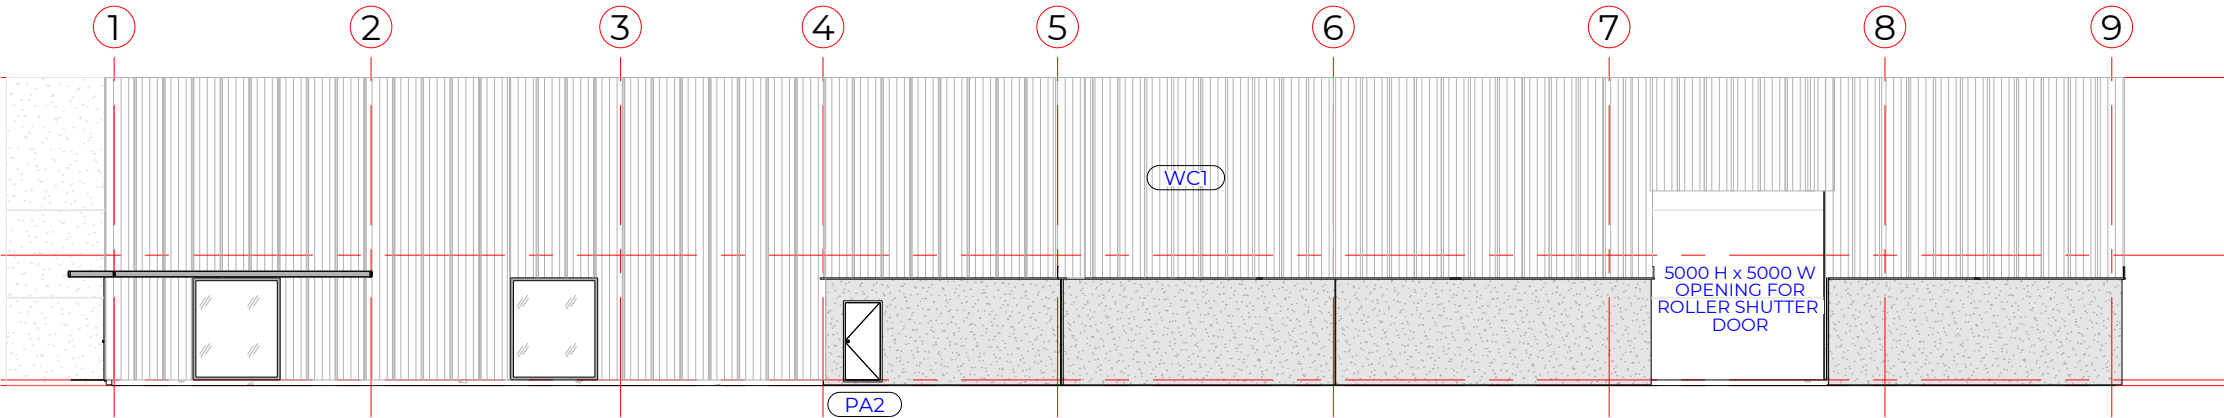

EAST ELEVATION

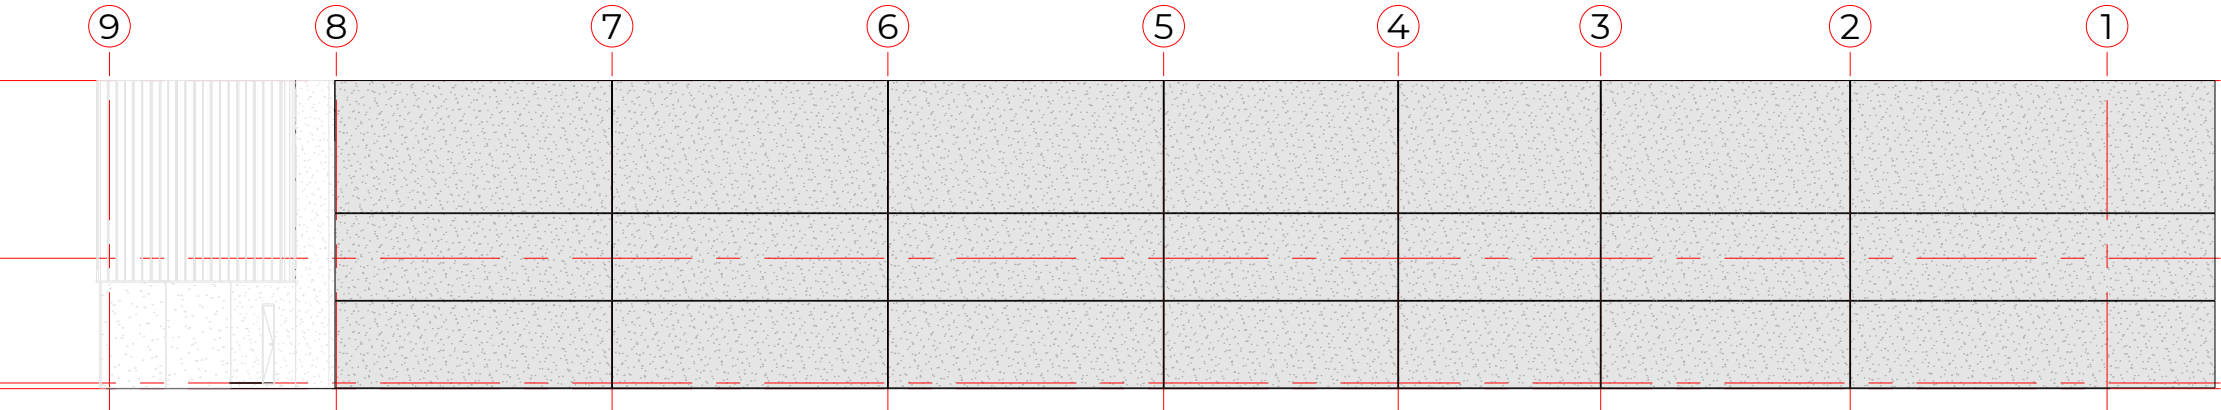

WEST ELEVATION

NOTE:
ALL CORNER AND BARGE FLASHINGS TO BE
ORDERED ON SITE

CLADDING SCHEDULE			
ITEM	NAME	PROFILE	FINISH
RF1	V-RIDGE		C/BOND TBC
RV1	500mm WHIRLY BIRD		C/BOND TBC
TF1	TOE FLASHING		MONUMENT
RC1	ROOF CLADDING	0.47-TCT-5RIB	C/BOND TBC
GC1	BOX GUTTER CLADDING	0.47-TCT-CORRY	ZINC
PC1	PARAPET CLADDING	0.47-TCT-CORRY	ZINC
WC1	WALL CLADDING	0.47-TCT-5RIB	MONUMENT

PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

ELEVATIONS

THESE DRAWINGS ARE TO SHOW THE DESIGN
INTENT OF THE BUILD. FOR ALL STRUCTURAL
ELEMENTS REFER TO THE ENGINEERING
DRAWINGS SUPPLIED BY CSB

SIZE A3 SCALE 1:200 PAGE 4 OF 5






JOB 21064

SHEET A2.01

REV A

REV	DESCRIPTION	DATE	DRAWN
A	PRELIMINARY	05/05/2025	AK



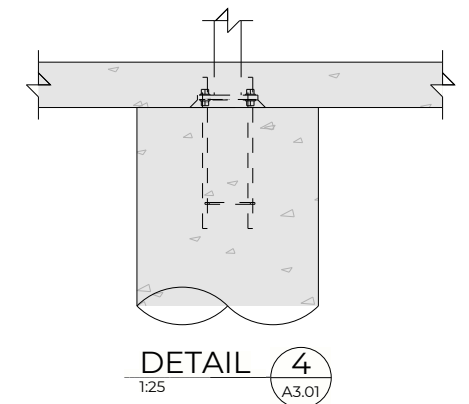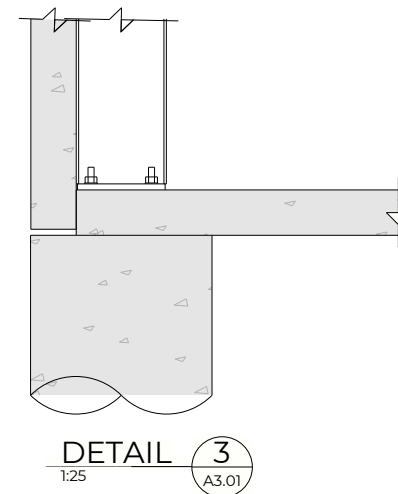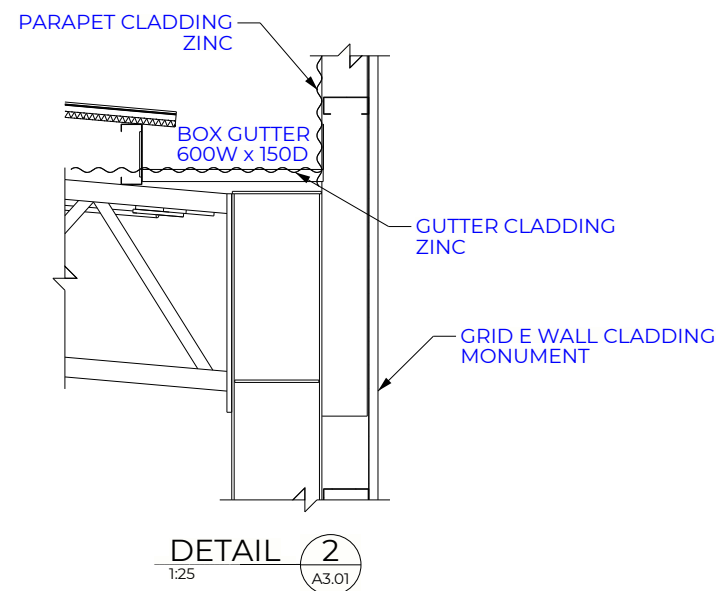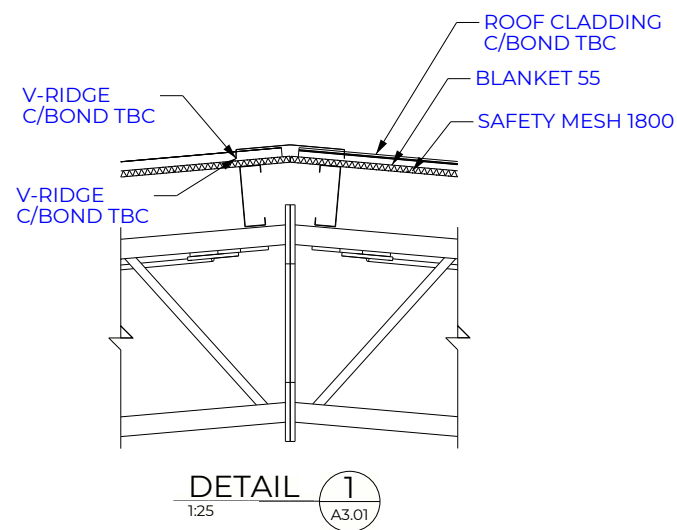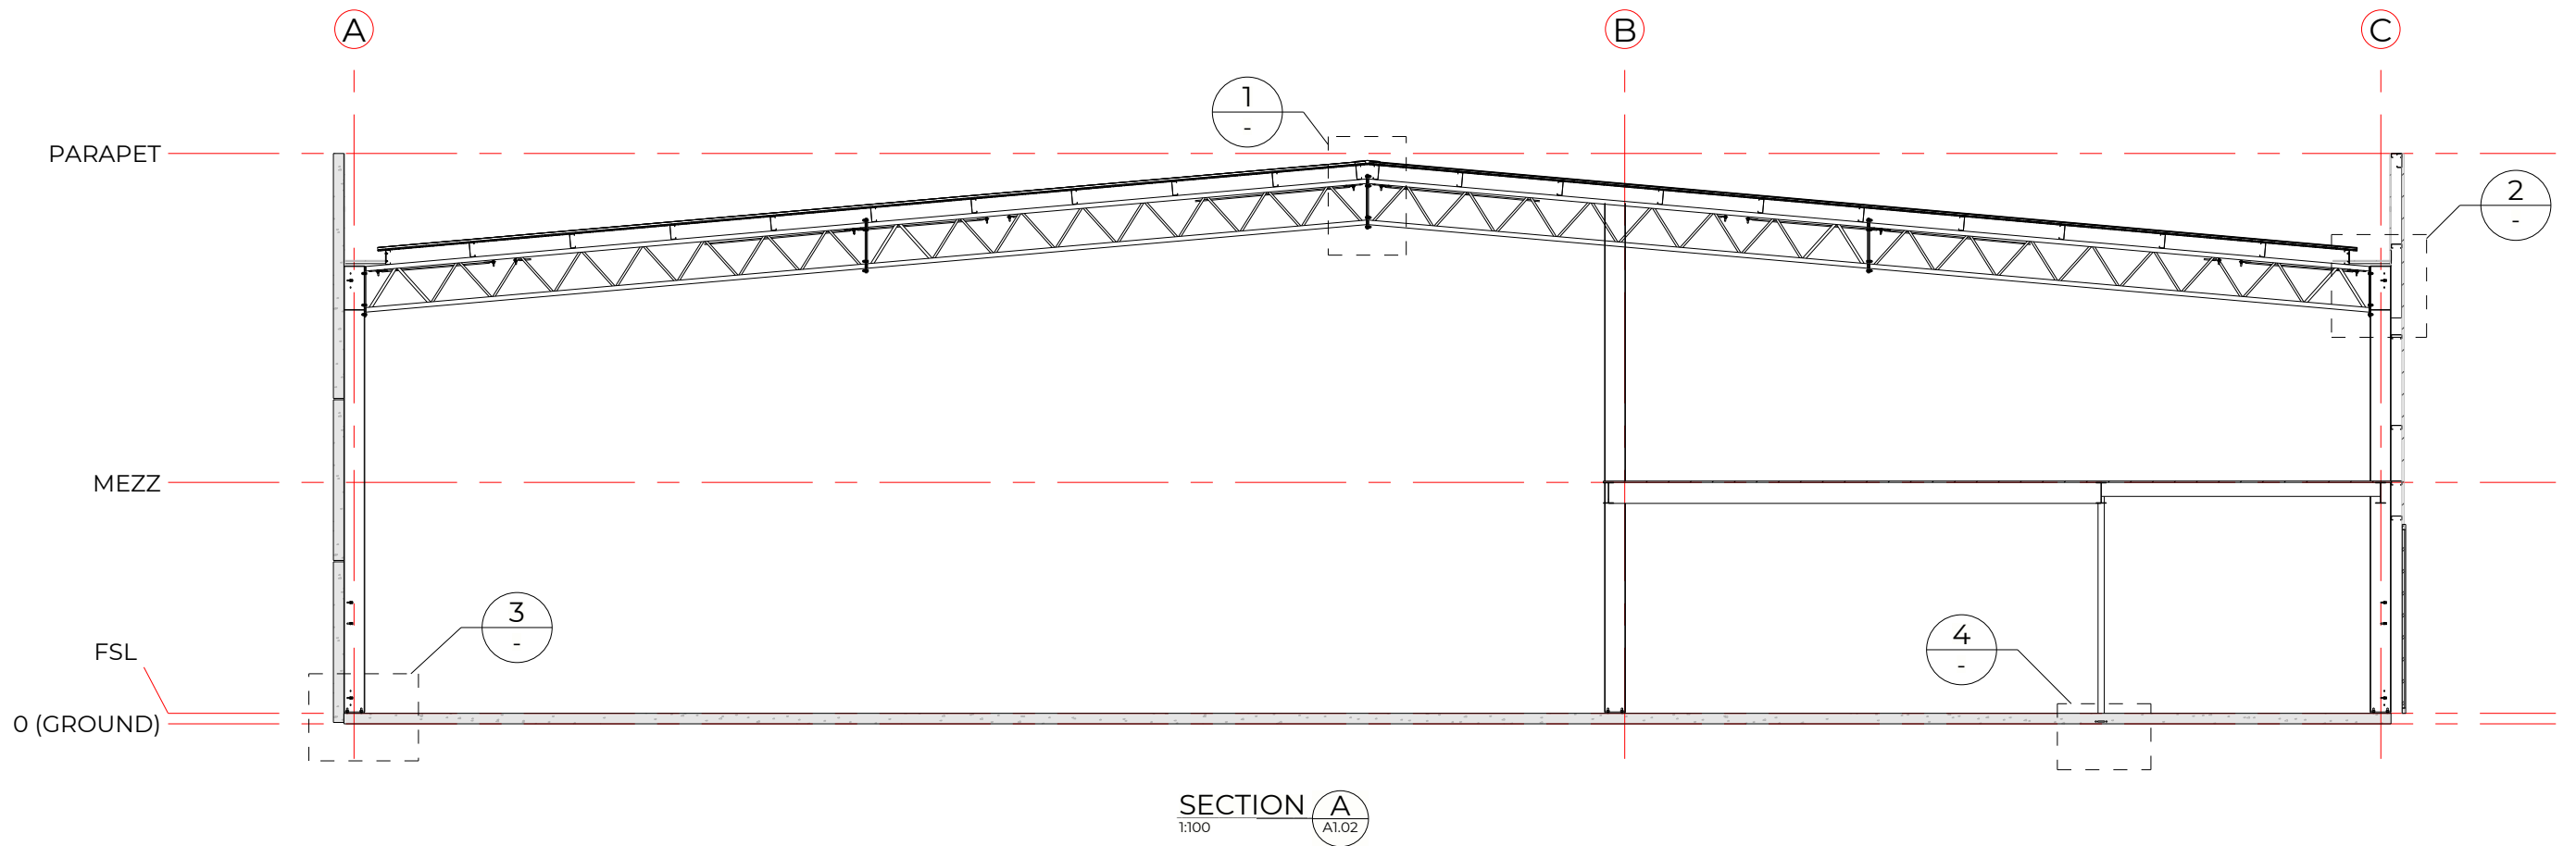

PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

SECTIONS & DETAILS

JOB 21064

SHEET A3.01

REV A


THESE DRAWINGS ARE TO SHOW THE DESIGN INTENT OF THE BUILD. FOR ALL STRUCTURAL ELEMENTS REFER TO THE ENGINEERING DRAWINGS SUPPLIED BY CSB

REV	DESCRIPTION	DATE	DRAWN
A	PRELIMINARY	05/05/2025	AK



SIZE A3 SCALE 1:100 PAGE 5 OF 5

**PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640**

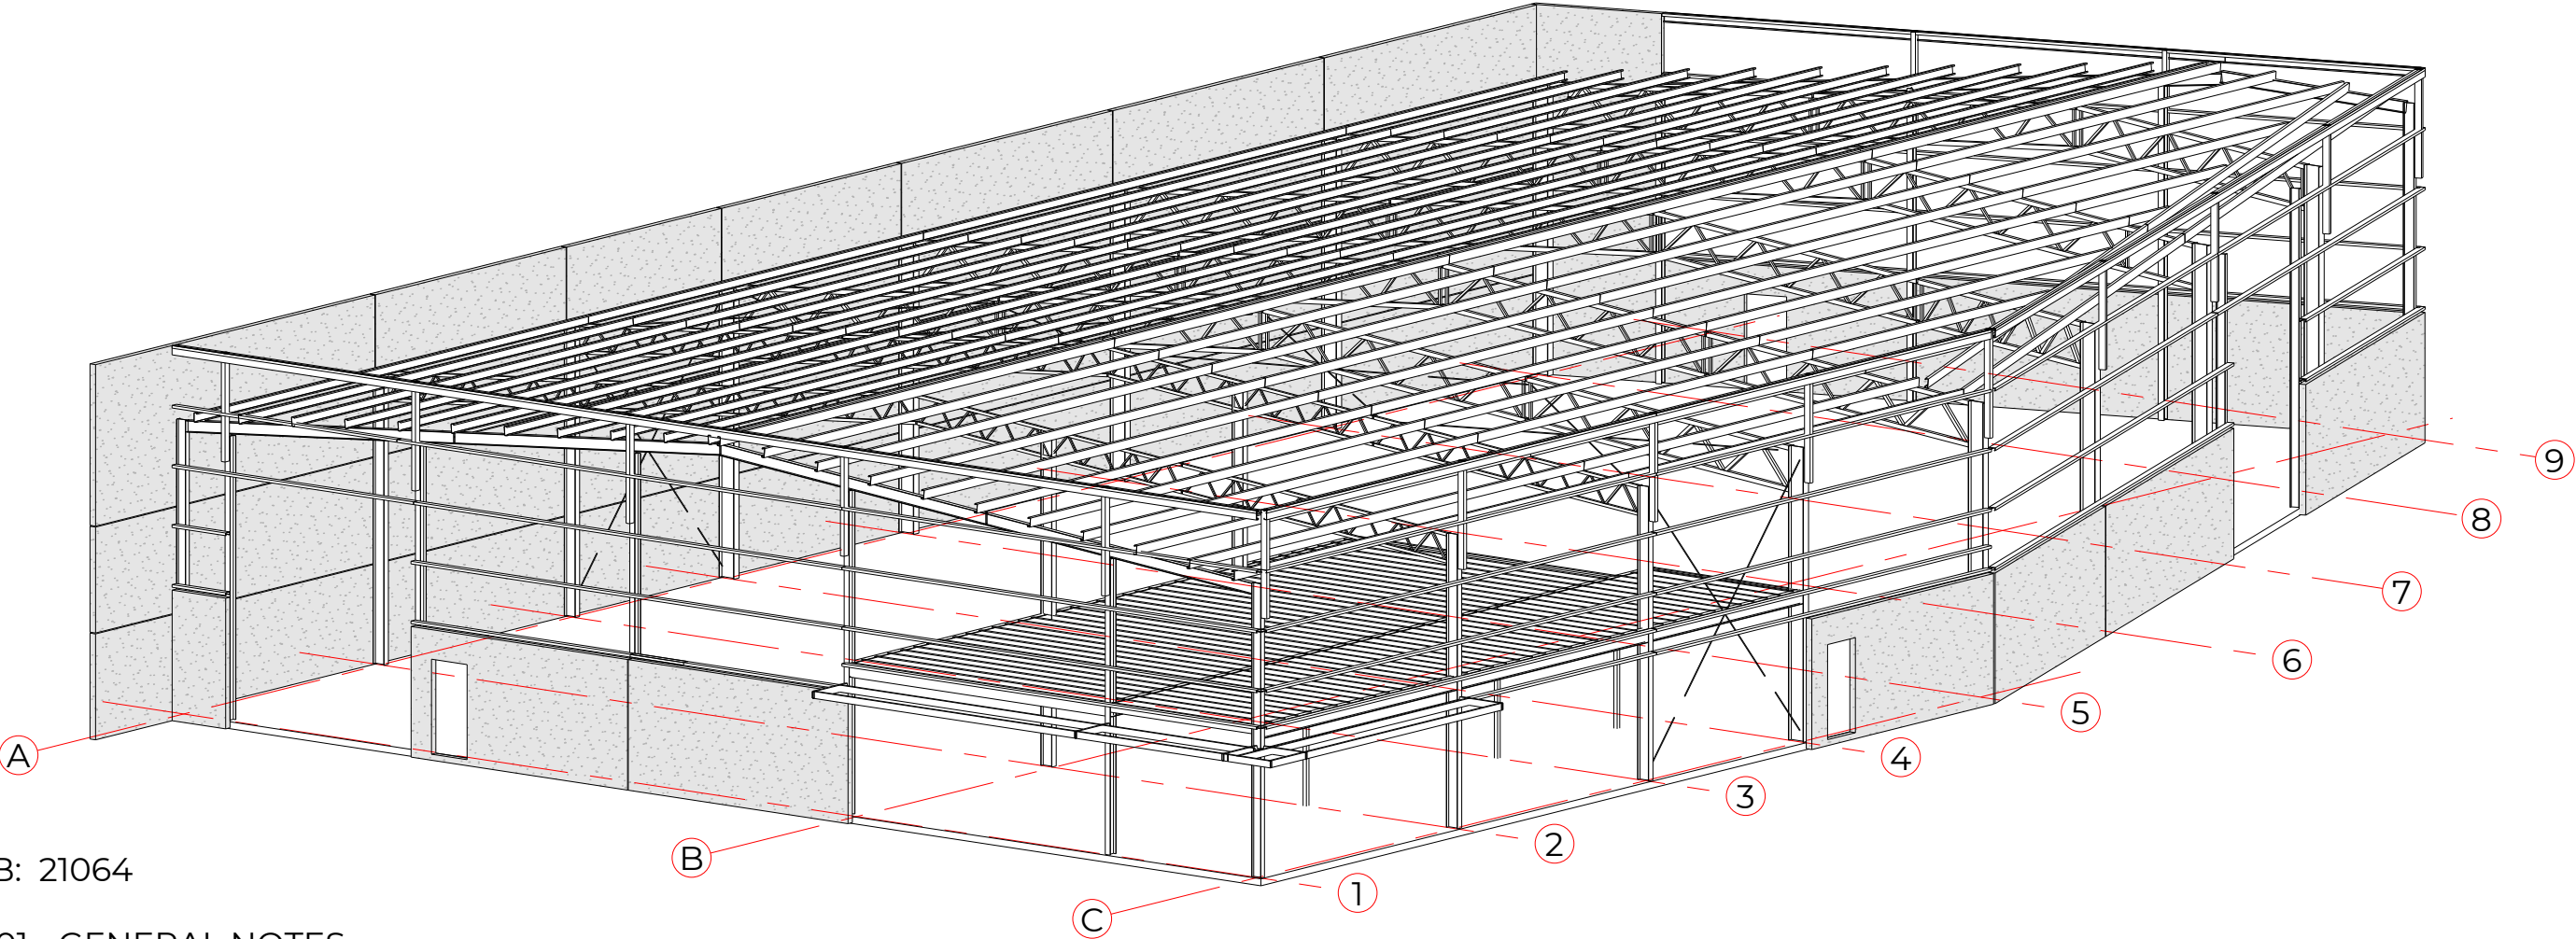

JOB: 21064

- S0.01 - GENERAL NOTES
- S1.01 - FOOTING PLAN
- S1.02 - MEZZANINE LAYOUT
- S1.03 - STRUCTURAL ROOF PLAN
- S2.01 - STRUCTURAL ELEVATIONS
- S3.01 - TYPICAL DETAILS SHT 1
- S3.02 - TYPICAL DETAILS SHT 2
- S3.03 - TYPICAL DETAILS SHT 3
- S4.01 - STANDARD STEEL DETAILS 1
- S4.02 - STANDARD STEEL DETAILS 2
- S4.03 - STANDARD STEEL DETAILS 3
- S4.04 - STANDARD STEEL DETAILS 4
- S5.01 - TYPICAL PANEL DETAILS



- GENERAL
- G1. THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL AND OTHER CONSULTANTS DRAWINGS AND SPECIFICATIONS WITH SUCH OTHER WRITTEN INSTRUCTIONS OR SKETCHES AS MAY BE ISSUED DURING THE COURSE OF THE CONTRACT, ANY DISCREPANCY SHALL BE REFERRED TO THE SUPERINTENDENT BEFORE PROCEEDING WITH WORK.

G2. DIMENSIONS AND LEVELS ARE TO BE OBTAINED FROM THE ARCHITECTURAL DRAWINGS AND ARE TO BE VERIFIED ON-SITE PRIOR TO COMMENCEMENT OF WORKS OR FABRICATION.

G3. ALL MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE RELEVANT CURRENT AUSTRALIAN STANDARDS INCLUDING ALL AMENDMENTS CURRENT AT THE TIME OF CONTRACT AWARD, BUILDING REGULATIONS, THE NATIONAL CONSTRUCTION CODE AND ANY OTHER RELEVANT STATUTORY AUTHORITIES, EXCEPT WHERE VARIED BY THE CONTRACT DOCUMENTS.

G4. THESE DRAWINGS MUST NOT BE SCALED.

G5. 3D AND ISOMETRIC VIEWS IN THESE DOCUMENTS ARE INDICATIVE ONLY AND SHOULD ONLY BE USED AS A VISUAL AID TO ASSIST IN THE INTERPRETATION OF THE ORTHOGRAPHIC DRAWINGS.

G6. DO NOT COMMENCE CONSTRUCTION USING THESE DRAWINGS UNTIL IT'S "ISSUED FOR CONSTRUCTION".

G7. THE FOUNDATION MATERIAL MUST HAVE A SAFE BEARING PRESSURE OF NOT LESS THAN 150KPA, FOUNDED ON NATURAL GROUND (UNO). ALL FOOTINGS MUST BE FOUNDED AT SPECIFIED DEPTH AND MIN. 100mm INTO NATURAL GROUND (UNO.)

G8. UNLESS NOTED OTHERWISE, ALL LEVELS ARE IN METERS AND ALL DIMENSIONS ARE IN MILLIMETERS.

G9. THE METHOD OF CONSTRUCTION AND THE MAINTENANCE OF SAFETY DURING CONSTRUCTION ARE THE RESPONSIBILITY OF THE PRINCIPAL CONTRACTOR. IF ANY STRUCTURAL ELEMENT PRESENTS DIFFICULTY IN RESPECT OF CONSTRUCTABILITY OR SAFETY, THE MATTER SHALL BE REFERRED TO THE STRUCTURAL ENGINEER FOR RESOLUTION BEFORE PROCEEDING WITH THE WORK.

G10. DURING CONSTRUCTION, THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERLOADED. THE BUILDER SHALL PROVIDE TEMPORY BRACING, SHORING AND PROPPING IN ORDER TO KEEP THE BUILDING WORKS AND EXCAVATIONS STABLE AT ALL TIMES.

G11. CENTRAL STEEL BUILD'S ENGAGEMENT IS TO PROVIDE DOCUMENTED DESIGN FOR THE PERMANENT CONDITION SUITABLE FOR THE DOCUMENTED INTENDED OCCUPANCY USE ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING THE STRUCTURE AND ANY ADJACENT STRUCTURES IN A SAFE AND STABLE CONDITION AT ALL TIMES DURING CONSTRUCTION. THE CONTRACTOR IS TO DEVELOP A DETAILED SAFE WORK METHOD STATEMENT OUTLINING THE CONSTRUCTION SEQUENCE AND METHODOLOGY. THE CONTRACTOR IS TO ENGAGE A QUALIFIED AND SUITABLY EXPERIENCED ERECTION ENGINEER TO REVIEW THE CONSTRUCTION METHODOLOGY AND PROVIDE DESIGN OF TEMPORARY WORKS (SUCH AS PROPPING AND TEMPORARY BRACING) TO SUIT THE CONSTRUCTION SEQUENCE AND METHODOLOGY CHOSEN BY THE PRINCIPAL CONTRACTOR.

G12. CENTRAL STEEL BUILD HAS NOT BEEN ENGAGED TO UNDERTAKE DESIGN OF LATERAL STABILITY RESTRAINTS FOR NON-STRUCTURAL PARTS AND COMPONENTS IN ACCORDANCE WITH AS1170.4 SECTION 8 (E.G. SERVICES, PLANT & EQUIPMENT, CEILINGS, FIXED AND NON-FIXED NON-STRUCTURAL ELEMENTS). SUCH DESIGN SHALL BE COMPLETED BY THE INSTALLATION CONTRACTORS, WHO MUST ENGAGE A SUITABLY QUALIFIED STRUCTURAL ENGINEER TO PROVIDE ALL RELEVANT CALCULATIONS, CERTIFICATION DOCUMENTATION AND AS-CONSTRUCTED DRAWINGS DEMONSTRATING COMPLIANCE TO AS1170.4 SECTION 8 TO THE SATISFACTION OF THE BUILDING CERTIFIER

G13. IMPORTED/LOCAL FILL SHOULD BE PLACED ONTO A COMPETENT BASE IN MAXIMUM 200mm LIFTS WITH EACH LIFT BEING COMPACTED TO 98% STANDARD COMPACTION DENSITY.

G14. CLADDING WEIGHT AND PROFILE AS SPECIFIED ON ARCHITECTURAL DRAWINGS. CLADDING IS TO BE INSTALLED TO AS1562(2018).

G15. PLASTERBOARD LINING - ARTICULATION JOINTS ARE TO BE PLACED IN PLASTERBOARD AT ROOF BEAM LOCATIONS FOR CEILINGS AND AT MAIN COLUMN LOCATIONS FOR WALLS, AT MAX 3000mm CENTRES. ADEQUATE APPROVED INSULATION PRODUCT AND EXPANSION/CONTRACTION ROOF/WALL SHEETING SCREWS TO BE ADOPTED BETWEEN ANY METAL ROOF/WALL SHEETING AND SUPPORTING PURLINS/GIRTS.

G16. WIRE ROPE BRACING TO BE IN ACCORDANCE WITH AS2759(2004). 3 GRIPS PER END. WIRE ROPE TO BE RE-TENSIONED AT COMPLETION OF CONSTRUCTION.

G17. ROOF PLUMBER TO ENSURE BOX GUTTERS ARE IN COMPLIANCE WITH AS3500.3(2021) AND TO DESIGN TO SUIT ON SITE DETERMINED DRAINAGE LOCATIONS. THE FOLLOWING DESIGN AND INSTALLATION PARAMETERS MUST BE ACHIEVED TO SATISFY THE REQUIREMENTS OF AS3500.3(2021). A BOX GUTTER MUST HAVE:
 - A MINIMUM SOLE WIDTH OF 200mm FOR DOMESTIC CLASS 1 BUILDINGS AND 300mm FOR OTHER BUILDING CLASSES.
 - A MINIMUM DEPTH OF 75mm AT THE HIGH END.
 - THE SOLE MUST BE SMOOTH TO PREVENT PERMANENT PONDING WITH THE GRADIENT BETWEEN THE RANGE OF 1:40 TO 1:200.
 - DISCHARGE AT THE DOWNSTREAM END WITHOUT CHANGE IN DIRECTION (IE. NOT TO THE SIDE).
 - BE STRAIGHT (WITHOUT CHANGE OF DIRECTION).
 - THE BOX GUTTER MUST BE SEALED TO THE RAINHEAD OR SUMP.
 - THE SOLE WIDTH MUST NOT BE REDUCED TOWARDS THE OUTLET WITHOUT A PROPORTIONAL INCREASE IN DEPTH.
 - WHERE SARKING IS INSTALLED, IT MUST BE A MIN. 25mm INTO THE BOX GUTTER.
 - NO PART OF THE OUTLET IS ABOVE THE SOLE OF THE SUMP OR RAINHEAD
 - LAP JOINTS TO HAVE 25mm LAPS, SEALED AND FASTENED IN THE DIRECTION OF FALL.

CONCRETE

C1. CONCRETE SIZES DO NOT INCLUDE FINISHES.

C2. NO HOLES, CHASES OR EMBEDMENTS OTHER THAN THOSE SHOWN ON THE DRAWINGS SHALL BE MADE IN CONCRETE ELEMENTS WITHOUT ENGINEER'S APPROVAL

C3. DEPTHS OF BEAMS ARE GIVEN FIRST AND INCLUDE SLAB THICKNESS. SLAB AND C3 BEAMS SHALL BE CAST TOGETHER UNLESS OTHERWISE NOTED.

C4. CONCRETE SHALL BE KEPT'S FREE OF SUPPORTING MASONRY WITH TWO LAYERS OF SUITABLE MEMBRANE (MALTHOID OR EQUIV). VERTICAL FACES SHALL BE SEPARATED BY 12mm BITUMINOUS CANITE.

C5. CONSTRUCTION JOINTS SHALL BE LOCATED TO THE SATISFACTION OF THE ENGINEER. BUILDER SHALL ALLOW FOR ALL NECESSARY CONSTRUCTION JOINTS.

C6. CAMBER TO SUSPENDED SLAB AND BEAMS SHALL BE 5 FOR EVERY 2500 OF SPAN UNLESS OTHERWISE NOTED.

C7. REINFORCEMENT IS SHOWN DIAGRAMMATICALLY AND IS NOT NECESSARILY IN TRUE PROJECTION. SPLICES TO REINFORCEMENT SHALL BE MADE ONLY AT THE LOCATION SHOWN OR AS OTHERWISE APPROVED BY THE ENGINEER.

C8. THIS TABLE IS TO ONLY BE USED WHERE CONCRETE STRENGTHS AND COVERS ARE NOT NOTED ON STRUCTURAL DRAWINGS.
- | ELEMENT | | COVER mm
SURFACES CAST
AGAINST GROUND | FORMED or
FINISHED | MINIMUM
GRADE
U.N.O. | EXPOSURE
CLASSIFICATION
U.N.O. |
|--------------------|----------------------|---------------------------------------------|-----------------------|----------------------------|--------------------------------------|
| FOOTINGS | | 75 | 50 | N32 | A2 |
| BLINDING | | - | - | N15 | A2 |
| COLUMNS | INTERNAL
EXTERNAL | 50
50 | 40
40 | N32
S32 | A1
A2 |
| WALLS | INTERNAL
EXTERNAL | 50
50 | 30
40 | N32
S32 | A1
A2 |
| BEAMS | INTERNAL
EXTERNAL | 50
50 | 30
40 | N32
S32 | A1
A1 |
| SLAB/BAND
BEAMS | INTERNAL
EXTERNAL | 50
50 | 20
40 | N32
S32 | A1
A1 |
- NOTES

i. COVER IS THE CLEAR DISTANCE BETWEEN ANY REINFORCING (INCLUDING FITMENTS) AND THE FACE OF THE STUCTURAL ELEMENT.

ii. FOR ALL EXTERNAL SURFACES, PROVIDE FULLY PLASTIC BAR CHAIRS. TIE WIRE SHALL NOT BE NAILED TO THE FORMS. REINFORCING BARS SHALL NOT BE USED TO KEEP FORMS APART AND A THROUGH TIE SYSTEM SHALL BE USED TO TIE FORMS.

iii. PROVIDE AN APPROVED VAPOUR BARRIER FOR SLABS, BEAMS AND THICKENING CAST AGAINST THE GROUND.

iv. THE COVERS SHALL BE MAINTAINED USING APPROVED BAR CHAIRS. IN SLABS THE BAR CHAIRS SHALL BE AT 800 x 800mm MAXIMUM CENTERS. BAR CHAIRS SHALL BE PROVIDED ALONG THE EDGES OF CONSTRUCTION JOINTS. STOP ENDS SHALL NOT BE USED TO MAINTAIN THE COVERS.

v. EXTERNAL ELEMENTS ARE THOSE EXPOSED TO WEATHER, RAIN AND WATER PENETRATION AND ARE CLASSIFIED B1 UNLESS NOTED OTHERWISE.

C9. CONCRETE SHALL BE HANDLED AND PLACED IN ACCORDANCE WITH SECTION 19 OF AS3600. CONCRETE SLUMP SHALL BE BETWEEN 60mm AND 80mm. PUMPED CONCRETE SLUMP MAY INCREASE TO 100mm. AGGREGATE SHALL BE DENSE AGGREGATE TO AS2758 (UNLESS OTHERWISE INDICATED) FROM AN APPROVED SOURCE. THE MAXIMUM SIZE OF COARSE AGGREGATE SHALL BE 20mm.

C10. EXTERNAL/EXPOSED CONCRETE ELEMENTS, GRADE S32 MINIMUM, SHALL MEET THE FOLLOWING REQUIREMENTS: MINIMUM PORTLAND CEMENT CONTENT 330 kg/m³ MAXIMUM WATER/CEMENT RATIO 0.5, SHRINKAGE LIMIT 700 MICRO-STRAIN AFTER 56 DAYS, AND CHLORIDE CONTENT RESTRICTED AS PER CLAUSE 4.9 OF AS3600. NO OTHER SALT SHALL BE ADDED.

C11. CONDUITS AND PIPES WHEN CAST IN SLABS OR WALLS ARE TO BE PLACED BETWEEN THE TWO REINFORCEMENT LAYERS, WHERE THERE IS ONLY ONE LAYER OF REINFORCEMENT, PROVIDE 50mm COVER TO CONDUIT. PROVIDE MINIMUM 3 x DIAMETER CLEARANCE BETWEEN CONDUITS.

C12. WHERE DISTRIBUTION BARS TO MAIN REINFORCEMENT ARE NOT SHOWN ON DRAWINGS PROVIDE MINIMUM N16 AT 400 CENTERS, LAPPED 500mm AT SPLICES.

C13. STRIPPING AND BACKPROPPING OF SOFFITS SHALL NOT OCCUR UNTIL CONCRETE HAS REACHED 75% OF SPECIFIED STRENGTH. NO MASONRY WALLS SHALL BE BUILT ON SUSPENDED ELEMENTS UNTIL REMOVAL OF ALL FORMS AND PROPS.

C14. ALL PULL-OUT BARS SHALL BE TEMP CORE OR QUENCHED AND TEMPERED PRODUK. ALL BENDING AND REBENDING OF REINFORCEMENT SHALL BE IN STRICT ACCORDANCE WITH THE REQUIREMENTS OF AS 3600.

C15. WHERE DRILL & EPOXY GROUT IS CALLED UP ON THE DRAWINGS USE RAMSET CHEMSET REQ 502 INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS OR AN APPROVED EQUIVALENT UNLESS NOTED OTHERWISE.

C16. REINFORCEMENT AND POST TENSIONING RATES NOTED IN THE DOCUMENTATION ARE AN ESTIMATE OF THE QUANTITIES REQUIRED FOR STUCTURAL ELEMENTS IN THE FINAL CASE ONLY. THE CONTRACTOR SHOULD MAKE APPROPRIATE ALLOWANCES FOR NON-STRUCTURAL ELEMENTS [e.g. TRIMMING OF SERVICES PENETRATIONS, KERBS, PLINTHS, SCREEDS ETC.] ROLLING MARGINS, WASTE AND ADDITIONAL QUANTITIES REQUIRED FOR CONSTRUCTION ACTIVITIES.

C17. REINFORCEMENT
 - ALL REINFORCEMENT TO BE IN ACCORDANCE WITH AS4671.
 - ALL REINFORCEMENT BARS AND MESH TO BE DEFORMED AND STRENGTH GRADE 500 (I.E. D500) UNLESS NOTED OTHERWISE.
- STRUCTURAL STEEL

SHALL COMPLY TO AS4100 & AS1538

S1. THE FABRICATOR SHALL BE RESPONSIBLE FOR THE SHOP DRAWINGS WHICH SHALL COMPLY WITH THESE DRAWINGS. ANY VARIATION SHALL BE APPROVED BY THE ENGINEER PRIOR TO FABRICATION.

S2. WHERE CONNECTION FORCES (IN KILONEWTONS) ARE SHOWN ON THE DRAWINGS, CONNECTIONS SHALL BE PROVIDED TO TRANSMIT THESE FORCES. CONNECTIONS SHALL PROVIDE FOR A MINIMUM FORCE OF 40KN.

S3. UNLESS OTHERWISE NOTED: WELDS TO BE 6mm CONTINUOUS FILLETS LAID DOWN WITH APPROVED WELDING CONSUMABLES. GUSSET PLATES TO BE 10mm THICK. BOLTS TO BE M20-8.8/S IN 22mm DIAMETER HOLES. PROVIDE A MINIMUM OF TWO BOLTS PER CONNECTION.

S4. FABRICATOR SHALL PROVIDE ALL FIXINGS FOR ARCHITECTURAL ELEMENTS ETC. WITHOUT WEAKENING STRUCTURAL MEMBERS IN ANY WAY.

S5. UNLESS OTHERWISE NOTED CAMBER SHALL BE PROVIDED TO ALL ROOF BEAMS, TRUSSES, PORTALS, ETC. AT 5 PER 2000 OF SPAN. NO MEMBER SHALL BE ERECTED WITH NEGATIVE CAMBER.

S6. ALL STEELWORK BELOW GROUND SHALL BE ENCASED BY 75mm OF CONCRETE.

S7. CONCRETE ENCASED STRUCTURAL STEEL TO BE WRAPPED WITH FGW41 PLACED 25mm CLEAR OF STEEL. PROVIDE 50mm MINIMUM ENCASING.

S8. ALL STRUCTURAL STEELWORK (UB/UC/PFC/EA/UA/SHS/RHS/CHS/PLT) SHALL BE HOT DIP GALVANISED IN ACCORDANCE WITH AS4680, AS1214 & AS2312. MINIMUM COATING THICKNESS OF 85 MICRONS.

S9. PURLINS TO BE GALVANISED HIGH STRENGTH STEEL STRIP COMPLYING WITH AS1397. MINIMUM STRESS YIELD OF 450MPa. ZINC COATING OF Z350 (350g/m² MINIMUM COATING MASS.) PURLINS TO COMPLY WITH AS4600(2005) AND MANUFACTURER'S INSTALLATION RECOMMENDATIONS.

S10. THE BOLTING PROCEDURE IS DESIGNATED AS FOLLOWS:
 - 4.6/S - REFERS TO COMMERCIAL BOLTS OF STRENGTH GRADE 4.6 TO AS1111 TIGHTENED USING A STANDARD WRENCH TO SNUG-TIGHT CONDITION.
 - 8.8/S - REFERS TO HIGH STRENGTH BOLTS OF STRENGTH GRADE 8.8 TO AS1252 TIGHTENED USING A STANDARD WRENCH TO A SNUG-TIGHT CONDITION.
 - 8.8/TF - REFERS TO HIGH STRENGTH BOLTS OF STRENGTH GRADE 8.8 TO AS1252 FULLY TENSIONED TO AS1511, DESIGNED AS A FRICTION TYPE JOINT.
 - 8.8/TB - REFERS TO HIGH STRENGTH BOLTS OF STRENGTH GRADE 8.8 TO AS1252 FULLY TENSIONED TO AS4100, DESIGNED AS A BEARING TYPE JOINT.

S11. ALL BOLTS SHALL BE OF SUCH A LENGTH THAT AT LEAST ONE FULL THREAD IS EXPOSED BEYOND THE NUT AFTER THE NUT HAS BEEN TIGHTENED.

S12. ALL FOOTING BOLTS TO HAVE A MINIMUM THREAD PROTRUSION OF 3 THREADS. FOOTING BOLTS TO HAVE MINIMUM 500 EMBEDMENT ON MAIN COLUMNS, 250 EMBEDMENT ON ALL OTHER FOOTINGS.

S13. MINIMUM ONE WASHER SHALL BE USED UNDER THE NUT IN ALL SITUATIONS. IF TIGHTENING IS CARRIED OUT AT THE HEAD, AN ADDITIONAL WASHER SHALL BE USED UNDER THE HEAD. FOR SLOTTED HOLES USE HARDENED WASHER UNDER THE NUT AND BOLT HEAD.

S14. UNLESS NOTED OTHERWISE, ALL MATERIAL TO BE:
 - GRADE 300 PLUS HOT ROLLED PLATES, FLATS, ANGLES TO AS/NZS 2678.
 - GRADE 300 PLUS UB, UC, PFC AND ANGLES.
 - GRADE 300 WB, WC.
 - GRADE C350L0 SHS, RHS, CHS.
 - GRADE 350L0 FOR ALL BENT PLATES AND MEMBERS.

S15. ALL WELDS SHALL BE STRUCTURAL PURPOSE WELDS IN ACCORDANCE WITH AS4100, AS1554.1 AND AS1554.2. SHEAR STUDS SHALL BE WELDED IN ACCORDANCE WITH AS1554.2. ALL WELDS SHALL BE GAS METAL ARC-WELDED USING B-G49 GRADE WELDING CONSUMABLES UNLESS NOTED OTHERWISE.

S16. BUILDER TO ALLOW FOR TRIMMING PURLINS TO HIPS, VALLEYS, OPENINGS, ETC. NOT SHOWN ON PLANS.

S17. CFW: DENOTES CONTINUOUS FILLET WELD.
FSBW: DENOTES FULL STRENGTH BUTT WELD.
FPBW: DENOTES FULL PENETRATION BUTT WELD.
PPBW: DENOTES PARTIAL PENETRATION BUTT WELD.
STEELWORK SYMBOLOLOGY:

DENOTES MOMENT CONNECTION

MS

DENOTES MOMENT SPLICE CONNECTION

DENOTES WEB SPLICE CONNECTION

DENOTES WEB CONNECTION

S18. REFER TO ARCHITECTURAL SPECIFICATIONS FOR DURABILITY AND PAINT TREATMENT OF ALL EXPOSED STEELWORK.

S19. STEELWORK FIRE RATING REQUIREMENTS ARE TO MEET THOSE SPECIFIED BY THE BUILDING SURVEYOR.
- S20. THE STRUCTURE HAS BEEN DESIGNED FOR THE FINAL CONDITIONS ONLY. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT DURING CONSTRUCTION THE STRUCTURE IS MAINTAINED IN A STABLE CONDITION AND NO PART OF THE STRUCTURE IS OVERSTRESSED.

S21. SAFETY MESH IS TO BE INSTALLED IN ACCORDANCE WITH AS 4389 SAFETY MESH OVER PURLINS IN ANY AREA WITH RISK OF FALLS FROM HEIGHT BEFORE ANY ROOF ACCESS BY PERSONNEL UNLESS OTHER SUITABLE MEANS OF FALL PROTECTION ARE EMPLOYED AT THE DISCRETION OF THE PRINCIPAL CONTRACTOR.
- | | |
|-------------------------------|-------|
| STRUCTURAL CERTIFICATION | |
| LAKER GROUP CHRISTOPHER AKERS | |
| REGISTRATION NO: PE0000845 | |
| SIGNED: | DATE: |
- | STRUCTURAL DESIGN DATA | | |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------|------------------------------|
| L1. CONSTRUCTION CATEGORY IN ACCORDANCE WITH THE REQUIREMENTS OF AS/NZS 5131. THE CONSTRUCTION CATEGORIES FOR THIS PROJECT ARE OUTLINED IN THE TABLE BELOW. | | |
| ELEMENT | ALL STRUCTURAL STEELWORK UNO | LIST OF EXCEPTIONS TO CC |
| IMPORTANCE LEVEL | - | |
| SERVICE CATEGORY | SC1 | |
| FABRICATION CATEGORY | FC1 | |
| CONSTRUCTION CATEGORY | CC- | |
| L2. THE STRUCTURAL COMPONENTS DETAILED ON THESE STRUCTURAL DRAWINGS HAVE BEEN DESIGNED IN ACCORDANCE WITH THE RELEVANT STANDARDS AUSTRALIA CODES AND THE BUILDING CODE OF AUSTRALIA FOR THE FOLLOWING LOADINGS. PLEASE REFER TO THE ARCHITECTURAL DRAWINGS PROPOSED FLOOR USAGE (IF ANY). | | |
| L3. SUPERIMPOSED LOADS | | |
| FLOOR USAGE | LIVE LOAD (kPa) | SUPERIMPOSED DEAD LOAD (kPa) |
| ROOF | - | - |
| MEZZ. FLOOR | - | - |
| SLAB CRANE | - | - |
| L4. WIND LOADS IN ACCORDANCE WITH AS1170.2 | | |
| BASIC WIND SPEED (m/s) | - | |
| REGION | - | |
| TERRAIN CATEGORY | - | |
| STRUCTURAL IMPORTANCE LEVEL | - | |
| L5. SNOW LOADS IN ACCORDANCE WITH AS1170.3 | | |
| SNOW REGION | - | |
| GROUND SNOW LOAD Sg (kN/m²) | - | |
| L6. EARTHQUAKE DESIGN PARAMETERS TO AS1170.4 | | |
| STRUCTURAL IMPORTANCE LEVEL AS DEFINED IN BCA PART B1 | - | |
| PROBABILITY FACTOR kp | - | |
| HAZARD FACTOR Z | - | |
| SITE SUB-SOIL CLASS | - | |
| EARTHQUAKE DESIGN CATEGORY | - | |
- PROPOSED WAREHOUSE 11


FOR GLENN BRAGANZA

20 PLATINUM COURT THURGOONA, NSW 2640
- GENERAL NOTES

JOB 21064

SHEET S0.01

REV A
- | | | | | |
|--------------------------------------------------------------------------------------------|-------|--------------|------------|-------------|
| THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER | REV | DESCRIPTION | DATE | DRAWN |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| SIZE A3 | SCALE | PAGE 2 OF 14 | A | PRELIMINARY |
| | | | 05/05/2025 | AK |
-
- © THIS DRAWING IS THE PROPERTY OF CENTRAL STEELBUILD. THIS DRAWING & ANY ASSOCIATED DRAWINGS AND/OR COMPUTATIONS MUST NOT BE MANUFACTURED FROM, COPIED OR TRANSMITTED TO A THIRD PARTY WITHOUT WRITTEN PERMISSION FROM CENTRAL STEELBUILD.

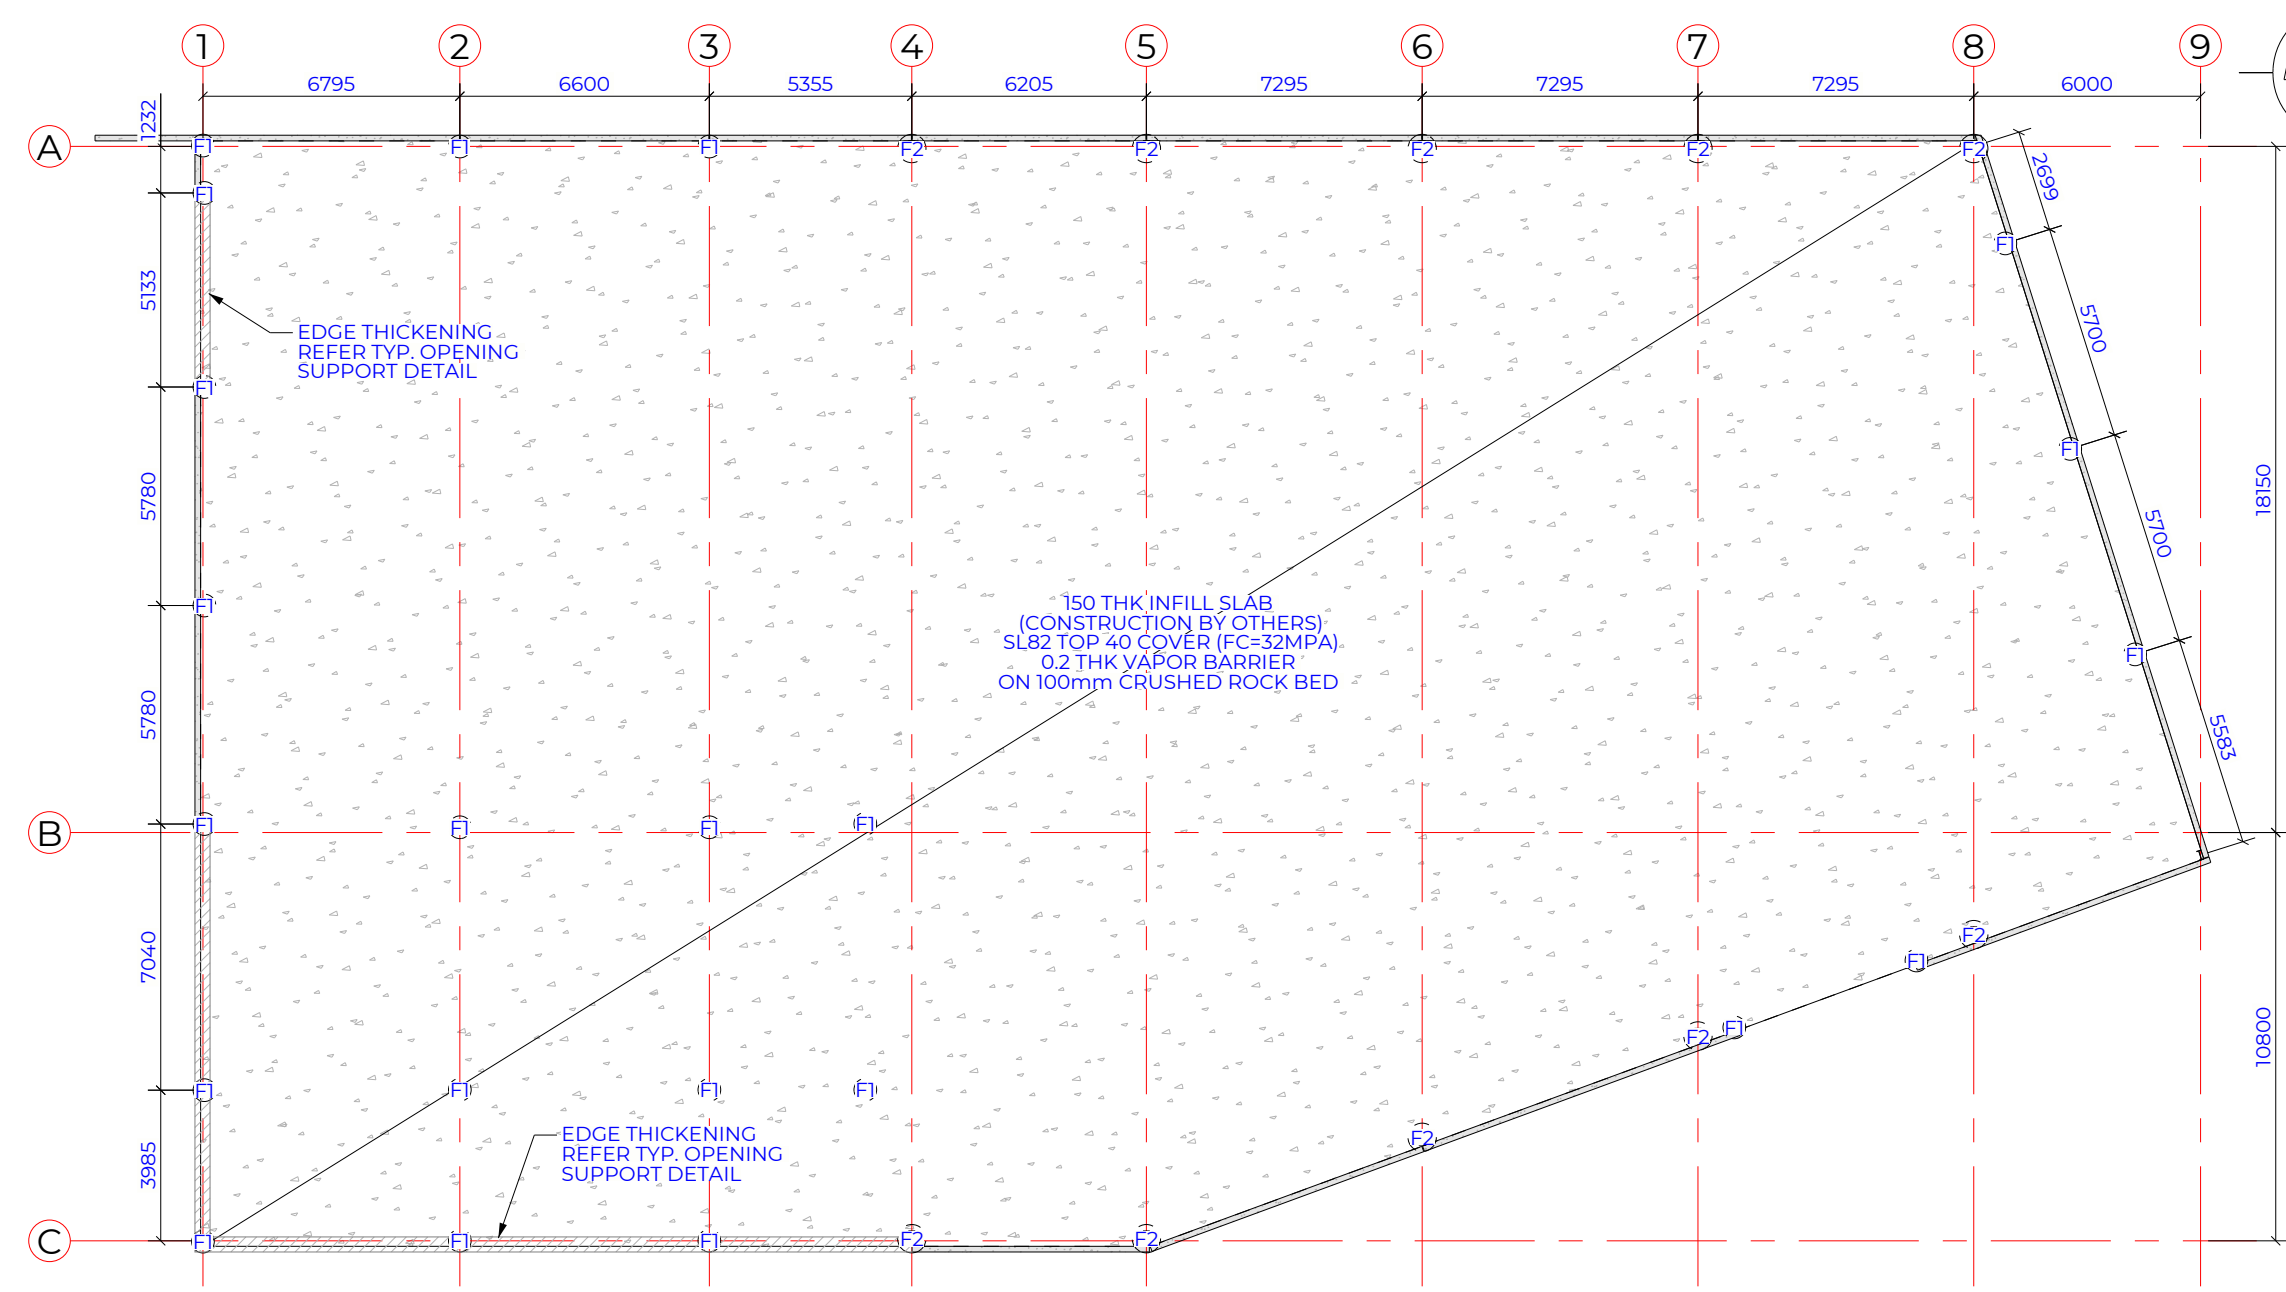

LAKER GROUP

STRUCTURAL CERTIFICATION

CHRISTOPHER AKERS

REGISTRATION NO: PE0000845






SIGNED: _____

DATE: _____

- FOUNDATION NOTES:**
- FOR ALL SLAB AND FOUNDATION PREPARATION REQUIREMENTS REFER TO GEOTECHNICAL ENGINEERS REPORT REF. XXXXXXXX BY XXXXXXXX DATED XXXXXXXX.
 - ALL BORED PIERS TO BE FOUNDED MIN. DEPTH SHOWN OR XXXX INTO NATURAL XXXXX (WHICHEVER IS GREATER) WITH XXXkPa MIN ALLOWABLE BEARING CAPACITY AND XXXkPa SKIN FRICTION AS PER GEOTECHNICAL ENGINEERS REPORT.
 - REFER GEOTECHNICAL REPORT FOR SLAB PREPARATION REQUIREMENTS. ANY EXISTING UNCONTROLLED FILL TO BE REMOVED AND REPLACED WITH ENGINEERED CONTROLLED FILL IN ACCORDANCE WITH AS3798-2007 AND GEOTECHNICAL ENGINEERS SPECIFICATIONS.
- CONCRETE PAVEMENT / SLAB ON GROUND**
- THE FOLLOWING PREPARATION PROCEDURES ARE SUGGESTED FOR A SILTY CLAY SUBGRADE EXPOSED BENEATH TOPSOIL AND STRIPPING OF ANY UNSUITABLE FILL.
- STRIP TOPSOIL, COMPRESSIBLE MATERIAL AND UNCONTROLLED FILLING FROM BENEATH THE PROPOSED SLAB AREAS TO THE REQUIRED DEPTH.
 - PROOF ROLL THE SUBGRADE USING A ROLLER HAVING A MINIMUM STATIC DRUM WEIGHT EQUIVALENT TO 6 TONNES PER METRE WIDTH TO OBSERVE THE SUBGRADE DEFLECTION AND DETECT WHETHER ANY SOFT SPOTS EXIST. ANY UNSTABLE ZONES THAT DO NOT IMPROVE AFTER FURTHER COMPACTION OR TREATMENT NEED TO BE EXCAVATED AND REPLACED WITH COMPACTED SUITABLE FILL. THE EXTENT OF TREATMENT IS BEST ASSESSED AT THE TIME OF CONSTRUCTION. PROOF ROLLING SHOULD BE WITNESSED BY A DP ENGINEER AND HOLD POINT PUT ON THE PLACEMENT OF FILL UNTIL THE STRIPPED SURFACE IS APPROVED. WHERE A ROCK SUBGRADE IS EXPOSED A VISUAL ASSESSMENT OF SUBGRADE CONDITION BY A GEOTECHNICAL ENGINEER SHOULD BE SUFFICIENT IN LIEU OF A PROOF ROLL.
 - ANY SELECT FILLING SHOULD COMPRISE MATERIAL OF LOW REACTIVITY SUCH AS LOW PLASTICITY CLAY, RIPPED SEDIMENTARY ROCK, SLIGHTLY CLAYEY SAND OR A PROCESSED CRUSHED ROCK WITH A SMOOTH GRADING CURVE. THE MAXIMUM PARTICLE SIZE AFTER COMPACTION SHOULD BE 40mm TO ENABLE ROUTINE COMPACTION CONTROL TESTING.
- ENGINEERED FILLING SHOULD BE PLACED IN HORIZONTAL LAYERS NO GREATER THAN 200mm LOOSE THICKNESS AND UNIFORMLY COMPACTED TO THE MINIMUM DRY DENSITY RATIOS OF 98% STANDARD FOR COHESIVE SOILS AND 100% STANDARD FOR GRANULAR MATERIALS.

MATERIALS SHOULD BE COMPACTED AT A PLACEMENT MOISTURE CONTENT OF 80% TO 115% OF STANDARD OPTIMUM MOISTURE CONTENT. CARE SHOULD BE TAKEN NOT TO OVER COMPACT OR PLACE CLAYEY FILLING TOO DRY OF STANDARD OPTIMUM TO MINIMISE THE EFFECTS OF POST CONSTRUCTION SWELLING.

- GENERAL NOTES:**
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH INSTALLER DWG. D1.01 FOOTING CAGE LAYOUT
 - 0 DATUM POINT IS TAKEN FROM TOP OF FOOTING AND/OR UNDERSIDE OF SLAB UNLESS NOTED OTHERWISE
 - IN THE EVENT OF CONFLICTING SETOUT INFORMATION INSTALLER DRAWINGS ARE TO TAKE PRECEDENCE

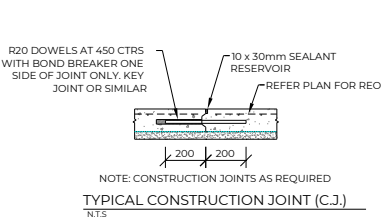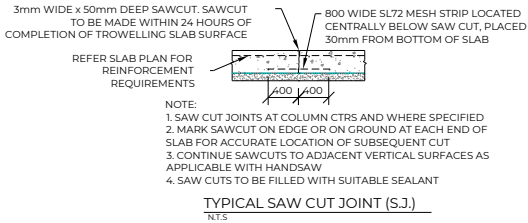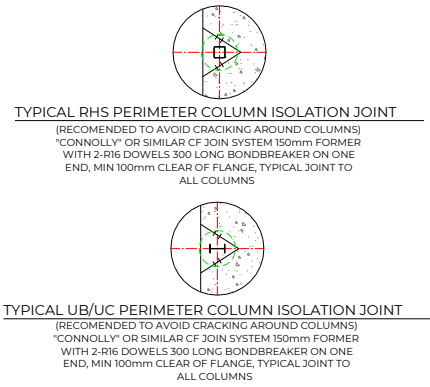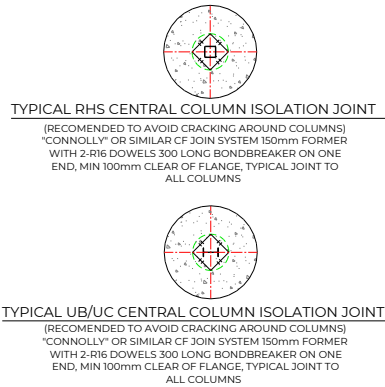

FOOTING SCHEDULE				
ITEM	SIZE	QTY	VOLUME (m3)	COMMENTS
F1	D600 x 1500 DEEP	22	0.42 EACH	BORED PIER
F2	D750 x 1500 DEEP	10	0.66 EACH	BORED PIER
TOTAL			15.90	DESIGNED FOOTING ALLOWANCE

PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

FOOTING PLAN

THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER



SIZE A3 SCALE 1:200 PAGE 3 OF 14

JOB 21064

SHEET S1.01

REV A



REV	DESCRIPTION	DATE	DRAWN
A	PRELIMINARY	05/05/2025	AK

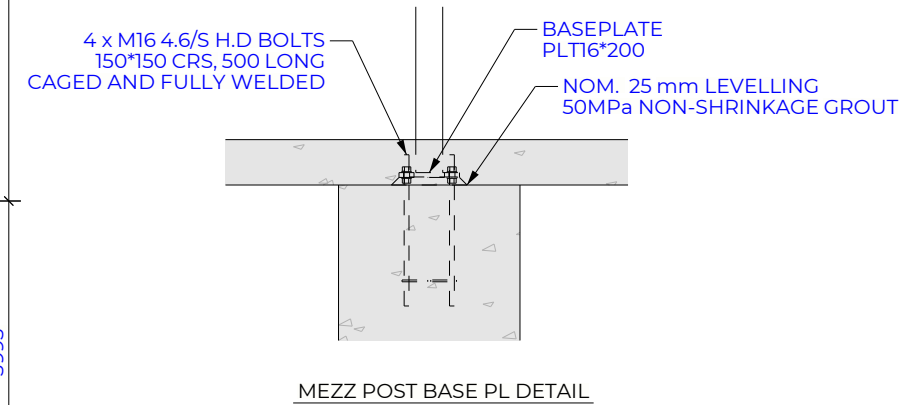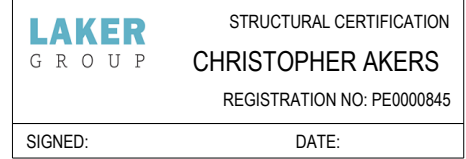

MEMBER SCHEDULE		
ITEM	SIZE	COMMENTS
B1	RHS150*50*2.0	CANOPY BEAM S3.01
B2	UB310*32	BEARER
C1	UB250*26	COLUMN
C2	UB310*32	COLUMN
C3	UB410*54	COLUMN
M1	UB200*22	MULLION
OR2	RHS150*50*2.0	OUTRIGGER S3.01
P1	SHS89*89*3.5	MEZZ POST

REV	DESCRIPTION	DATE	DRAWN
4	A PRELIMINARY	05/05/2025	AK



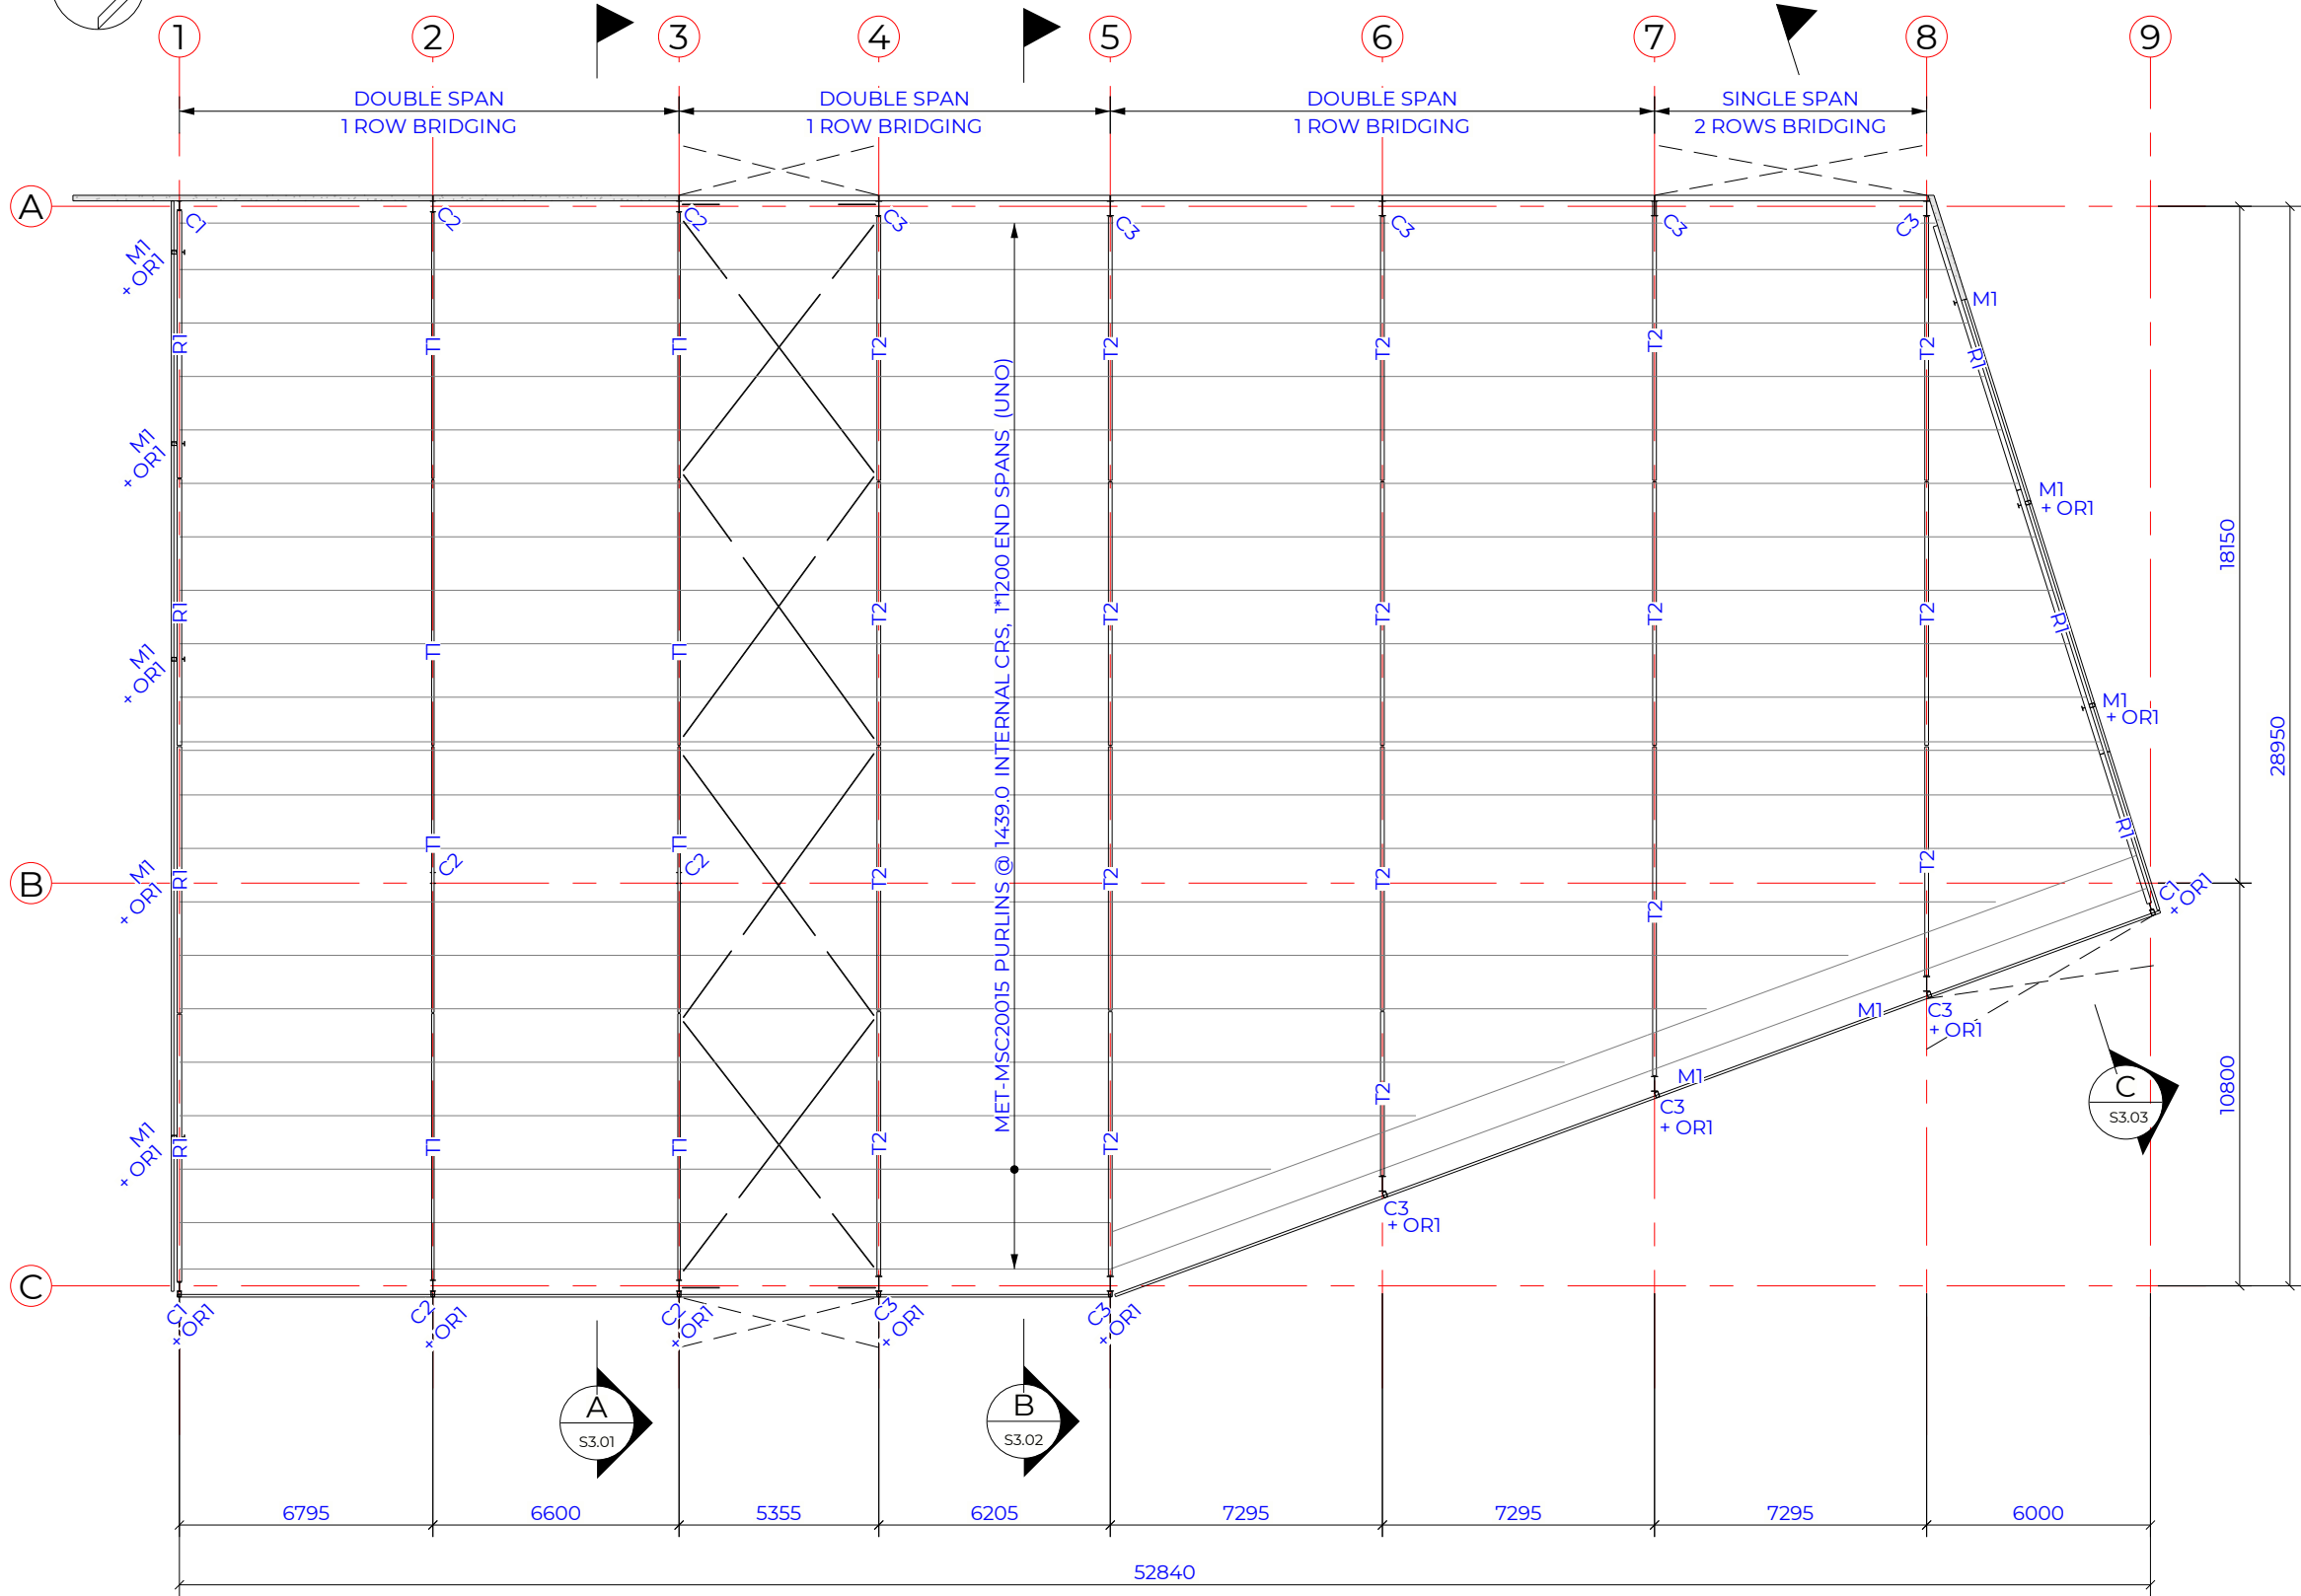

SOLAR NOTE:
ALLOWANCE MADE FOR 15kg PER SQM

MEMBER SCHEDULE		
ITEM	SIZE	COMMENTS
C1	UB250*26	COLUMN
C2	UB310*32	COLUMN
C3	UB410*54	COLUMN
M1	UB200*22	MULLION
OR1	RHS150*100*4.0	OUTRIGGER
R1	UB250*26	RAFTER S3.01
T1	WEB TRUSS	FOR DETAILS, REFER TO PAGE S3.01
T2	WEB TRUSS	FOR DETAILS, REFER TO PAGE S3.01

PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

STRUCTURAL ROOF PLAN

JOB 21064


SHEET S1.03

REV A

THESE DRAWINGS SHALL BE READ IN
CONJUNCTION WITH STRUCTURAL
COMPUTATIONS SUPPLIED BY
LAKER

REV	DESCRIPTION	DATE	DRAWN
A	PRELIMINARY	05/05/2025	AK




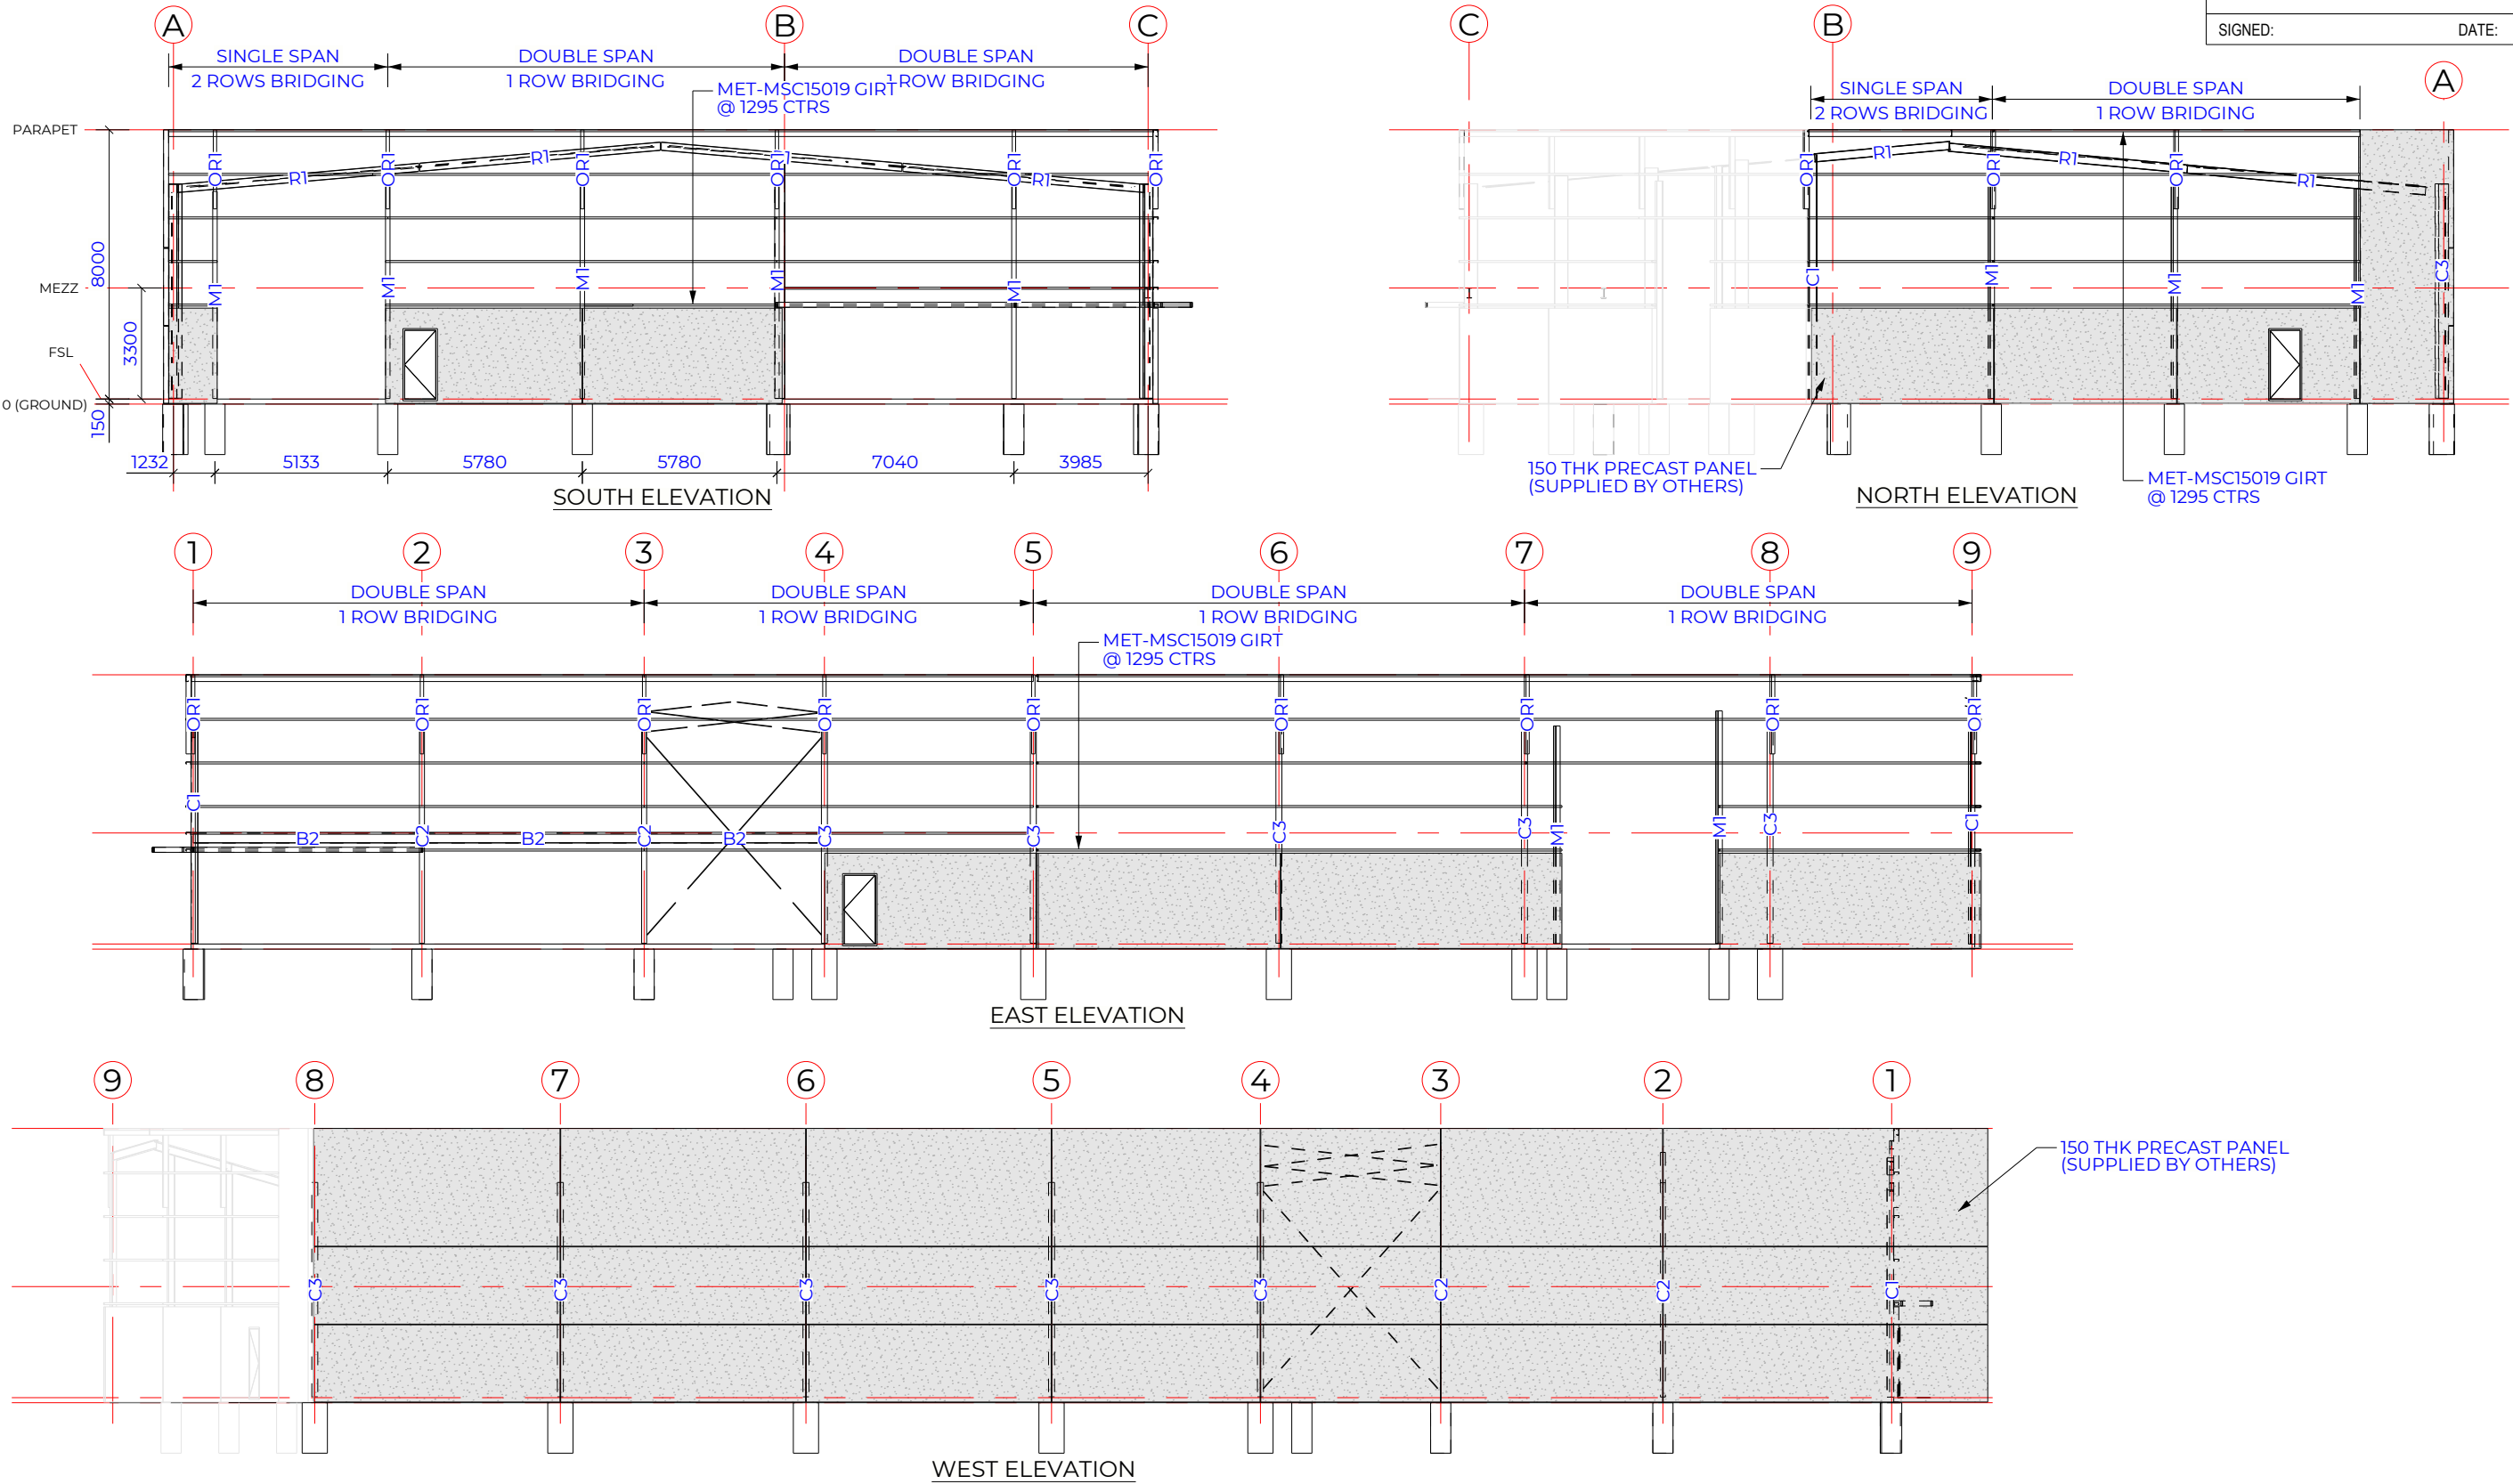





PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

STRUCTURAL ELEVATIONS		JOB 21064	SHEET S2.01		REV A
THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER	REV	DESCRIPTION	DATE	DRAWN	
SIZE A3 SCALE 1:200 PAGE 6 OF 14		A PRELIMINARY	05/05/2025	AK	



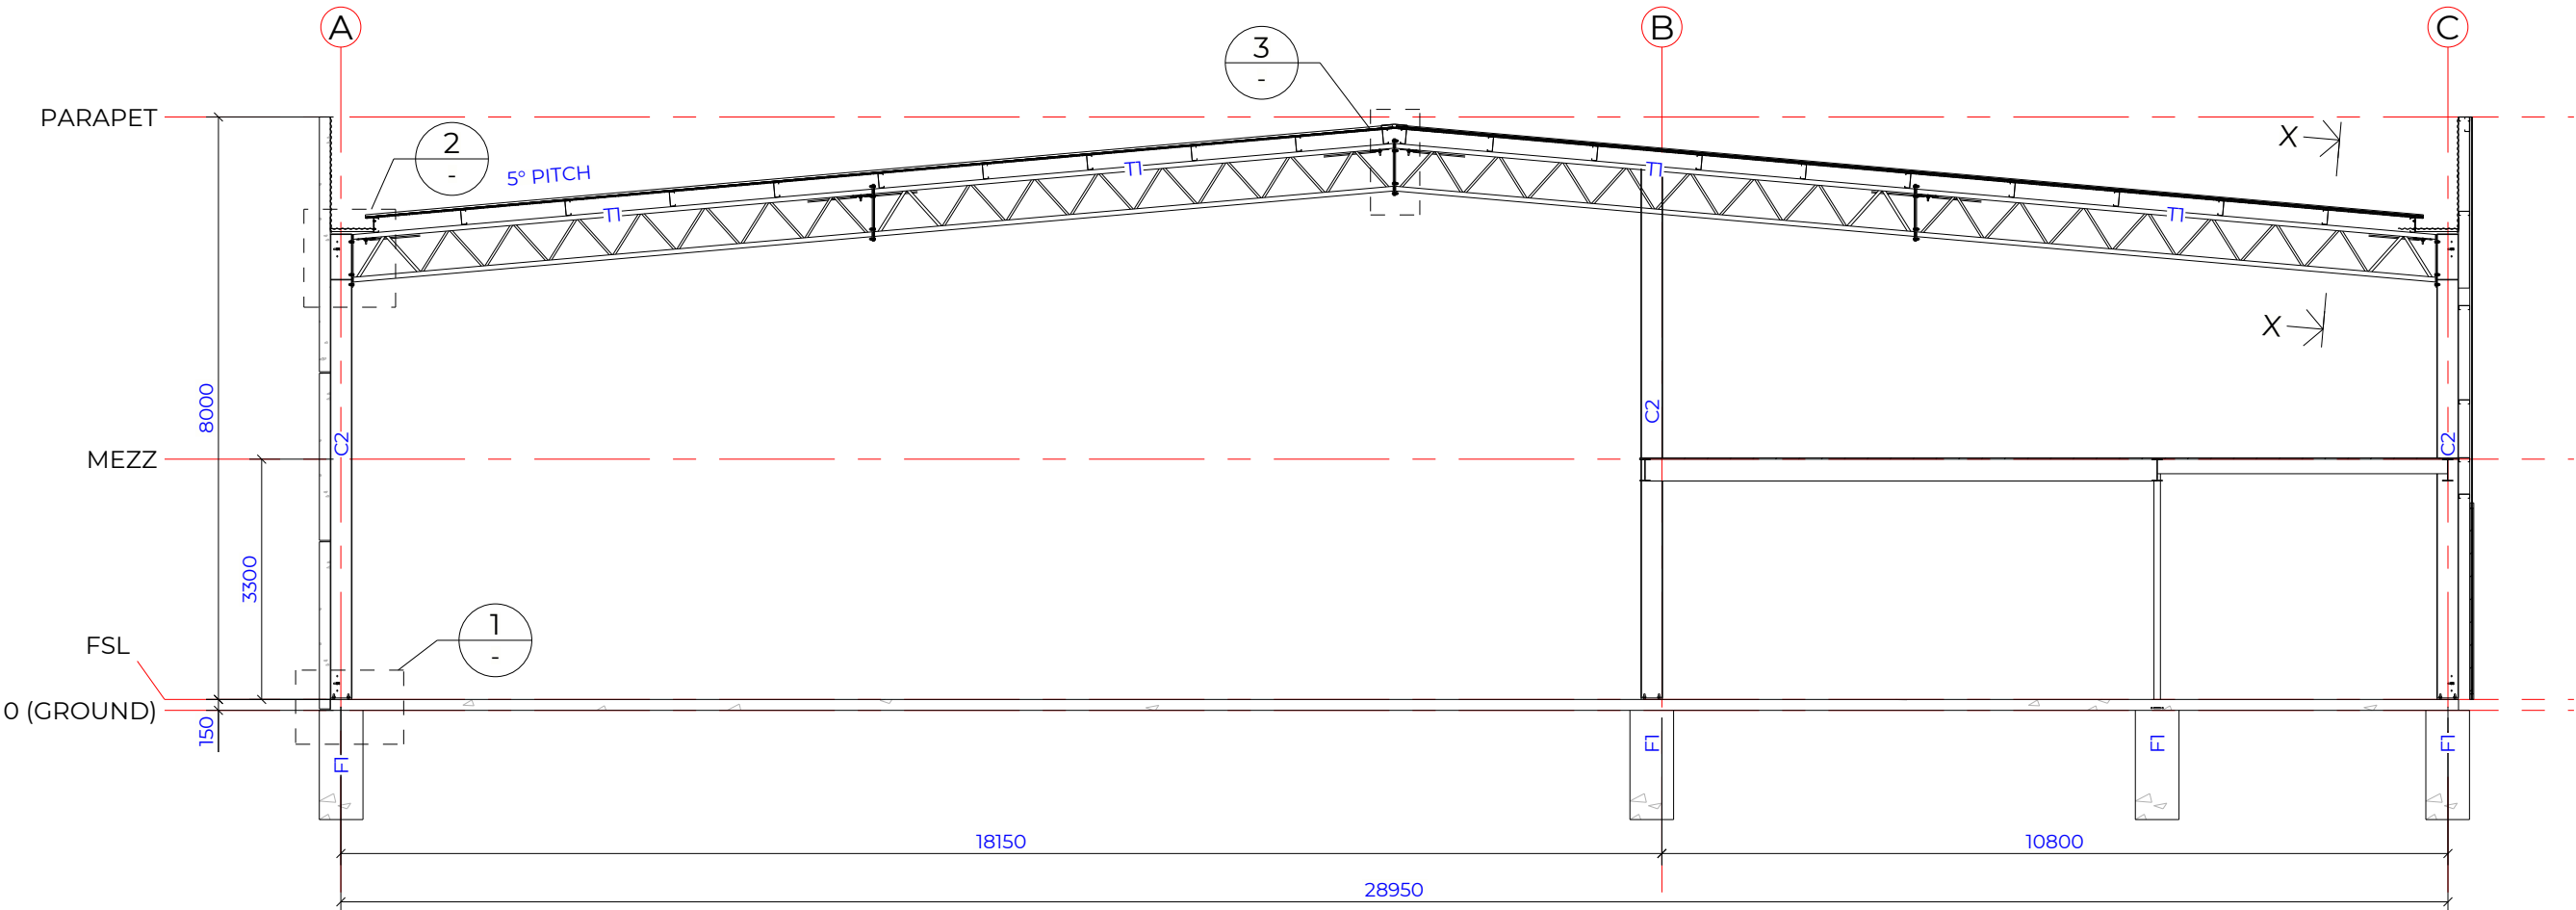

SECTION A
1:100
S1.03

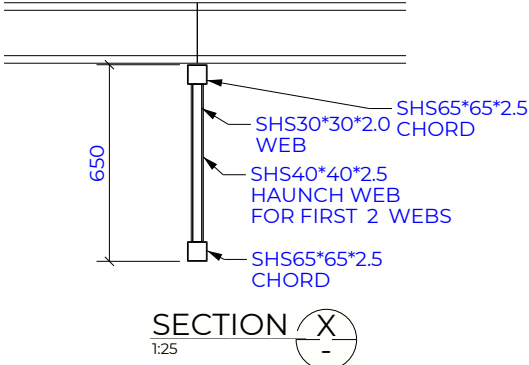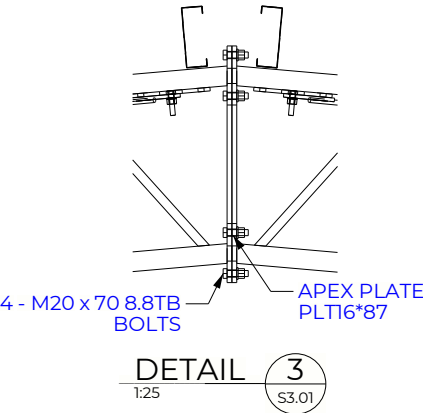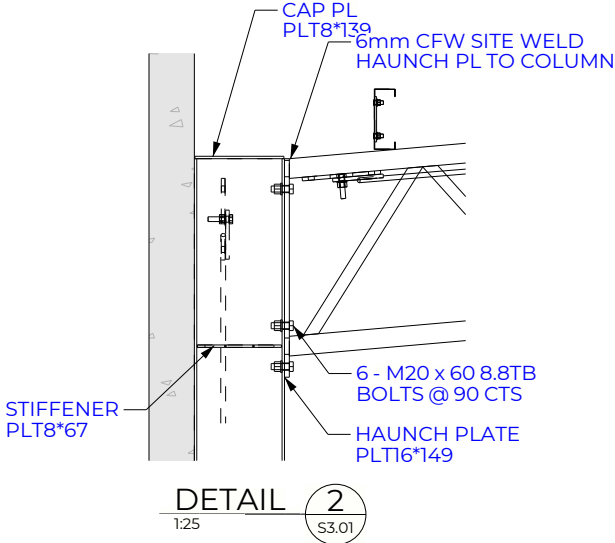
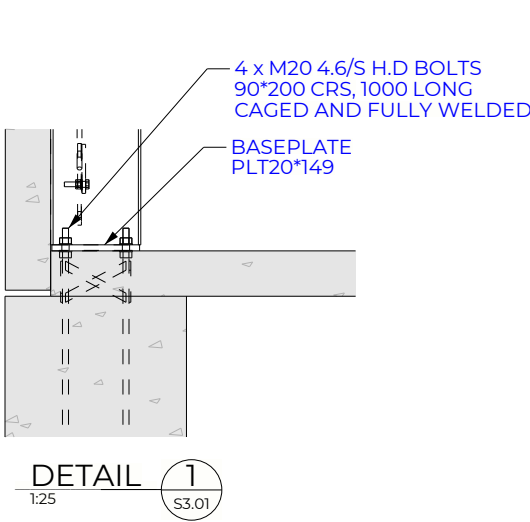


PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

TYPICAL DETAILS SHT 1JOB 21064SHEET S3.01REV A

THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER	REV	DESCRIPTION	DATE	DRAWN
SIZE A3 SCALE 1:100 PAGE 7 OF 14	A	PRELIMINARY	05/05/2025	AK



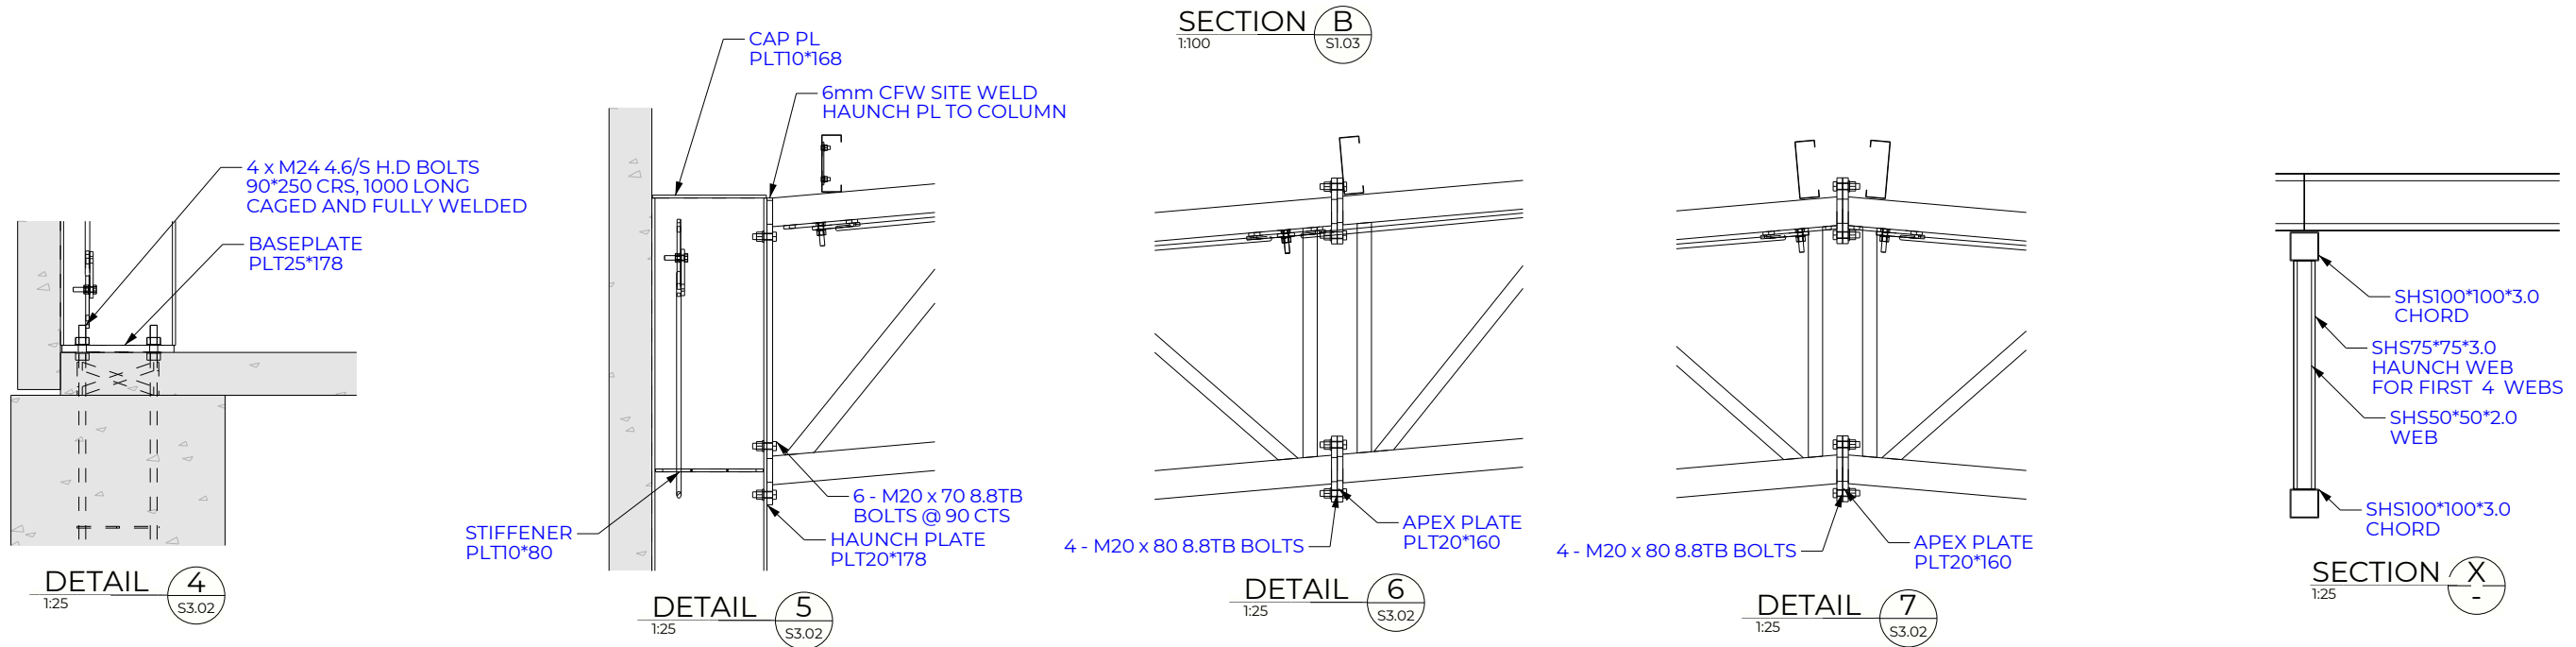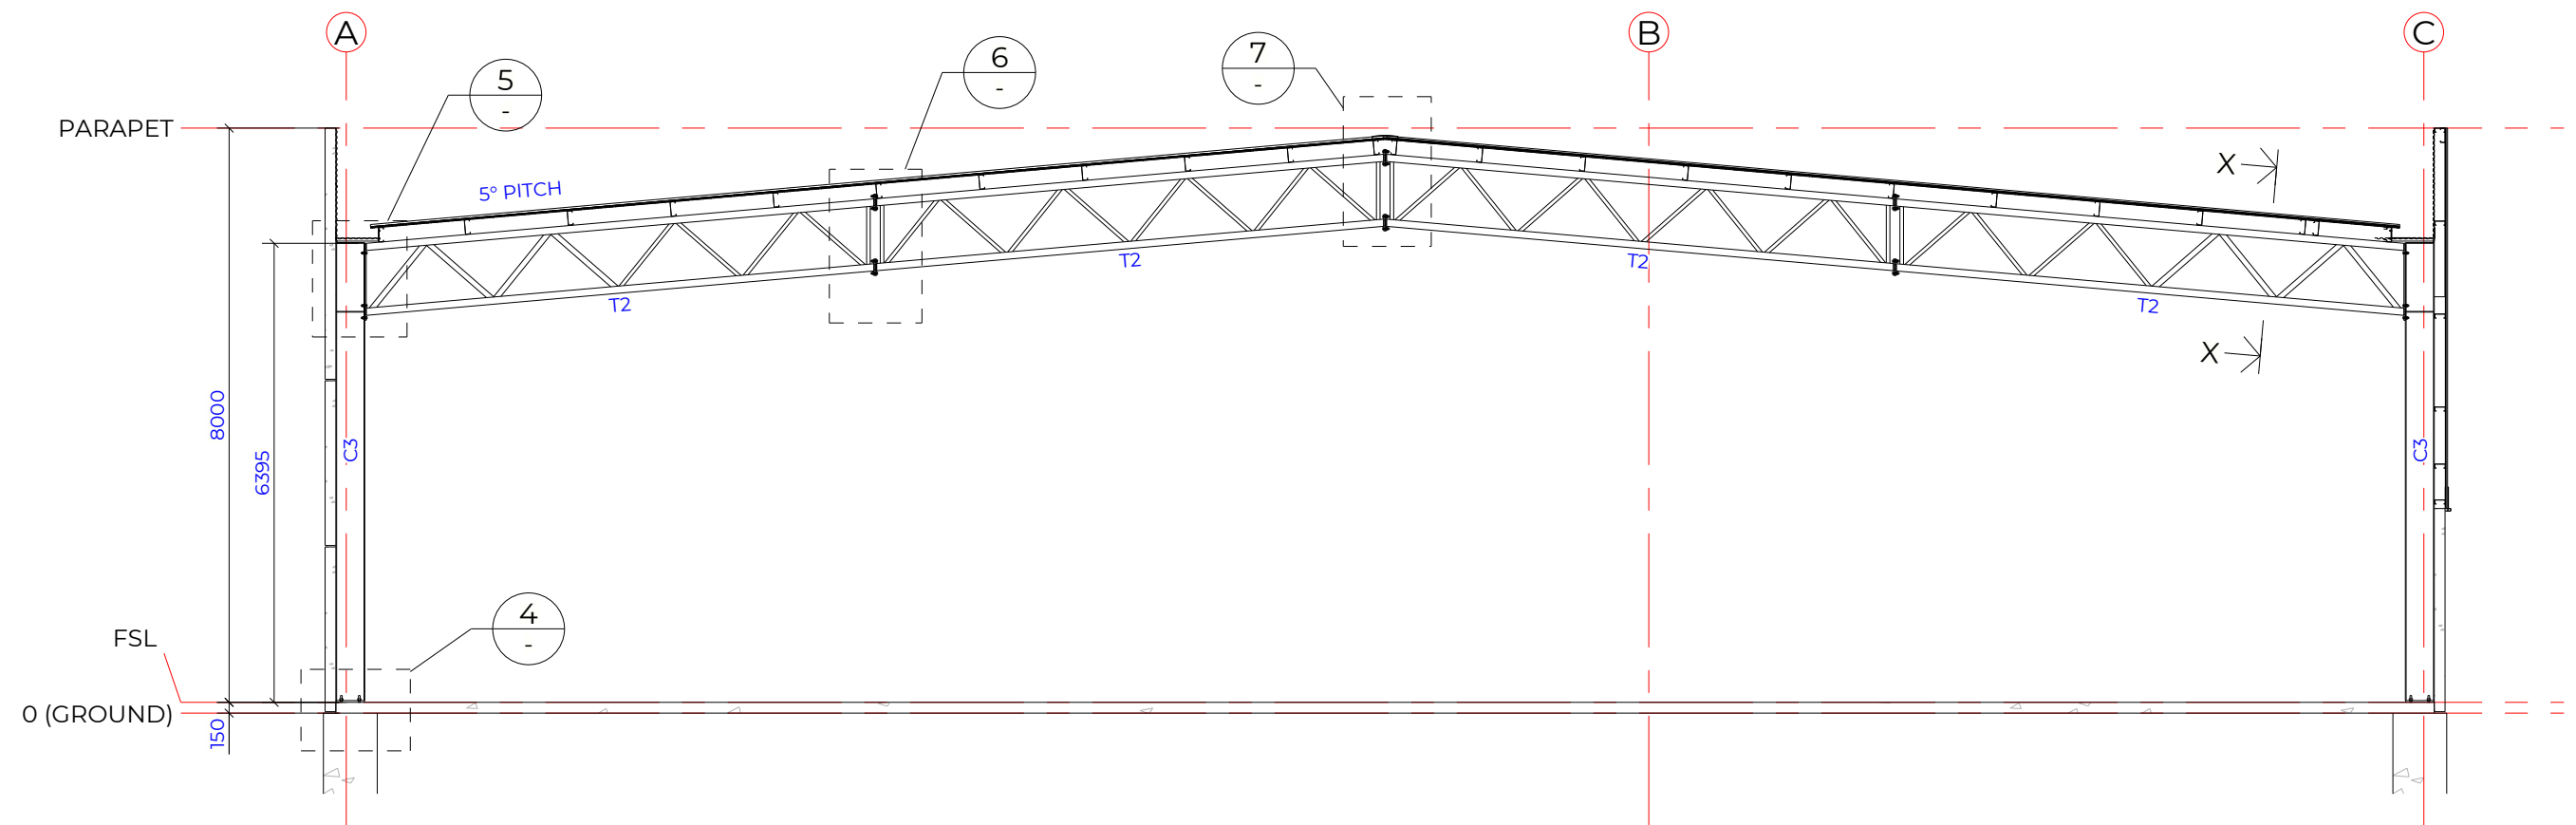


PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

TYPICAL DETAILS SHT 2JOB 21064SHEET S3.02REV A

THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER

REV	DESCRIPTION	DATE	DRAWN
A	PRELIMINARY	05/05/2025	AK




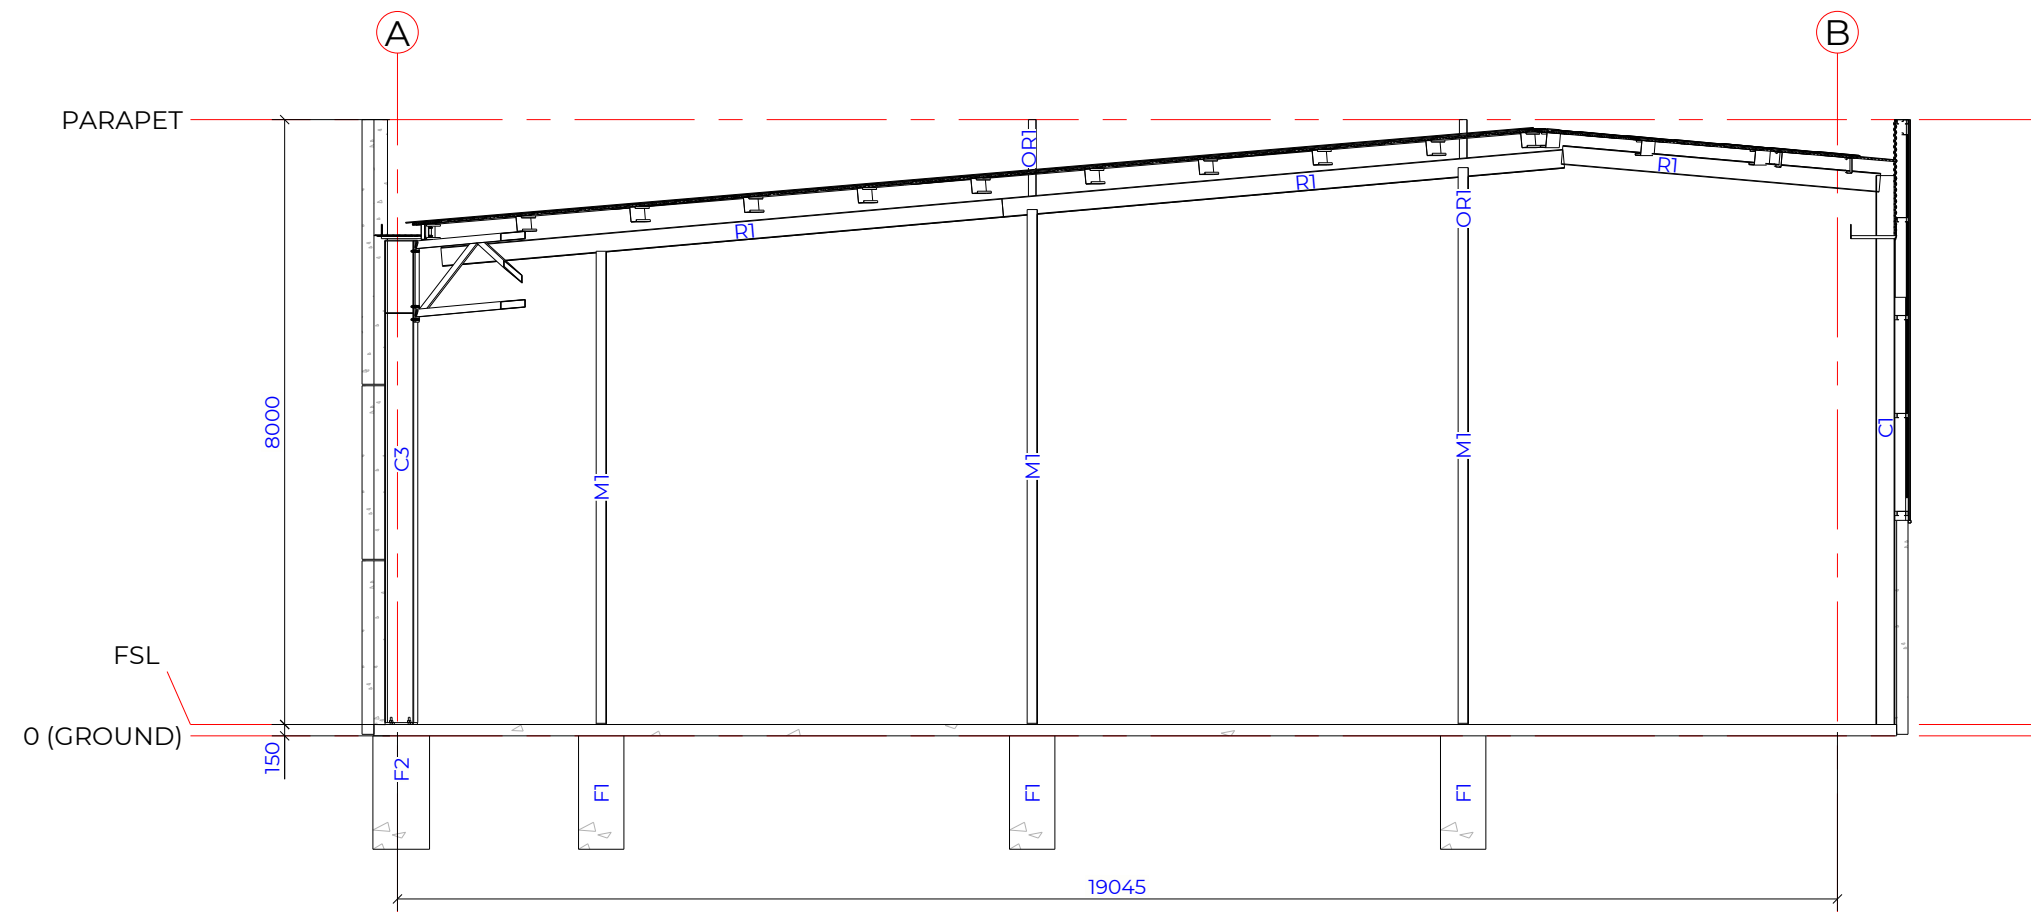

SECTION C
1:100
S1.03
(REAR WALL NOT SHOWN FOR CLARITY)


PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

TYPICAL DETAILS SHT 3		JOB 21064	SHEET S3.03	REV A
THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER	REV	DESCRIPTION	DATE	DRAWN
SIZE A3 SCALE 1:100 PAGE 9 OF 14	A	PRELIMINARY	05/05/2025	AK




UB/UC BASEPLATE DETAIL

TEKLA COMPONENT = CSEL_BASE_AND_CAGE




RHS BASEPLATE DETAIL

TEKLA COMPONENT = CSEL_BASE_AND_CAGE



SHS/CHS BASEPLATE DETAIL

TEKLA COMPONENT = CSEL_BASE_AND_CAGE



PFC BASEPLATE DETAIL

TEKLA COMPONENT = CSEL_BASE_AND_CAGE


BASE PLATE & FOOTING CAGE DETAILS							
	STEEL MEMBER SIZE	'A' BASE PLATE WIDTH	'B' BASE PLATE WIDTH	'T' BASE PLATE THICKNESS	'C' BOLT HOLE CENTRES	'D' BOLT HOLE CENTRES	'BS' HOLD DOWN BOLT SIZE
UB PROFILES	UB150*14	110	138	16	70	70	M16 4.6S
	UB150*18	110	143	16	70	70	M16 4.6S
	UB180*16	110	161	16	70	100	M16 4.6S
	UB180*18	110	163	16	70	100	M16 4.6S
	UB180*22	110	167	16	70	100	M16 4.6S
	UB200*18	110	186	16	70	120	M16 4.6S
	UB200*22	133	190	16	70	120	M16 4.6S
	UB200*25	133	191	16	70	120	M16 4.6S
	UB200*30	134	195	16	70	120	M16 4.6S
	UB250*26	130	240	16	70	150	M20 4.6S
	UB250*31	146	243	16	70	150	M20 4.6S
	UB250*37	146	245	16	70	150	M20 4.6S
	UB310*32	149	286	20	90	200	M20 4.6S
	UB310*40	165	292	20	90	200	M20 4.6S
	UB310*46	166	295	20	90	200	M20 4.6S
	UB360*45	171	340	20	90	250	M20 4.6S
	UB360*51	171	344	20	90	250	M20 4.6S
	UB360*57	172	347	20	90	250	M20 4.6S
	UB410*54	178	391	25	90	250	M24 4.6S
	UB410*60	178	394	25	90	250	M24 4.6S
	UB460*67	190	442	25	120	300	M24 4.6S
	UB460*75	190	445	25	120	300	M24 4.6S
	UB460*82	191	448	25	120	300	M24 4.6S
	UB530*82	209	516	25	120	350	M30 4.6S
	UB530*92	209	521	25	120	350	M30 4.6S
	UB610*101	228	590	25	120	400	M30 4.6S
	UB610*113	228	595	25	120	400	M30 4.6S
	UB610*125	229	600	25	120	400	M30 4.6S
1. WELDS TO BASE PLATES TO BE 6mm CFW (UNO)							


BASE PLATE & FOOTING CAGE DETAILS							
	STEEL MEMBER SIZE	'A' BASE PLATE WIDTH	'B' BASE PLATE WIDTH	'T' BASE PLATE THICKNESS	'C' BOLT HOLE CENTRES	'D' BOLT HOLE CENTRES	'BS' HOLD DOWN BOLT SIZE
UC PROFILES	UC150*23	152	140	16	90	90	M16 4.6S
	UC150*30	153	146	16	90	90	M16 4.6S
	UC150*37	154	150	16	90	90	M16 4.6S
	UC200*46	203	191	16	120	120	M16 4.6S
	UC200*52	204	194	16	120	120	M16 4.6S
	UC200*60	205	198	16	120	120	M16 4.6S
	UC250*73	254	242	16	150	150	M20 4.6S
	UC250*90	256	248	16	150	150	M20 4.6S
	UC310*97	305	296	20	180	180	M20 4.6S
	UC310*118	307	303	20	180	180	M20 4.6S
	UC310*137	309	309	20	180	180	M20 4.6S
RHS PROFILES	RHS250*150	260	360	20	200	300	M20 4.6S
	RHS200*100	198	298	20	150	250	M20 4.6S
	RHS150*100	198	248	20	150	200	M16 4.6S
	RHS150*50	148	248	20	100	200	M16 4.6S
	RHS125*75	173	223	16	125	175	M16 4.6S
	RHS100*50	148	198	12	100	150	M16 4.6S
SHS/ CHS PROFILES	SHS250 OR CHS219	360	360	20	300	300	M20 4.6S
	SHS200 OR CHS165	310	310	20	250	250	M20 4.6S
	SHS150 OR CHS140	248	248	20	200	200	M16 4.6S
	SHS125 OR CHS114	223	223	16	175	175	M16 4.6S
	SHS100 OR CHS100	198	198	12	150	150	M16 4.6S
	SHS89 OR CHS89	187	187	12	139	139	M16 4.6S
	SHS75 OR CHS75	173	173	12	125	125	M16 4.6S
PFC PROFILES	PFC380	100	368	20	-	250	M20 4.6S
	PFC300	90	288	12	-	200	M20 4.6S
	PFC250	90	238	12	-	150	M20 4.6S
	PFC230	75	218	12	-	150	M20 4.6S
	PFC200	75	188	12	-	120	M16 4.6S
	PFC180	75	169	12	-	100	M16 4.6S
	PFC150	75	140.5	12	-	70	M16 4.6S
1. WELDS TO BASE PLATES TO BE 6mm CFW (UNO)							

PROPOSED WAREHOUSE 11


FOR GLENN BRAGANZA

20 PLATINUM COURT THURGOONA, NSW 2640


STANDARD STEEL DETAILS 1			JOB 21064		SHEET S4.01		REV A	
THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER	REV	DESCRIPTION		DATE	DRAWN	<div></div>		
SIZE A3	SCALE 1:1	PAGE 10 OF 14	A	PRELIMINARY	05/05/2025	AK		




ROOF FLY BRACE CONNECTION PLATE DETAIL

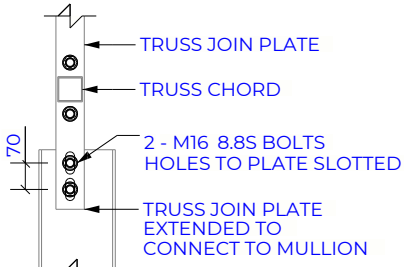


UB MULLION TO TRUSS JOIN PLATE

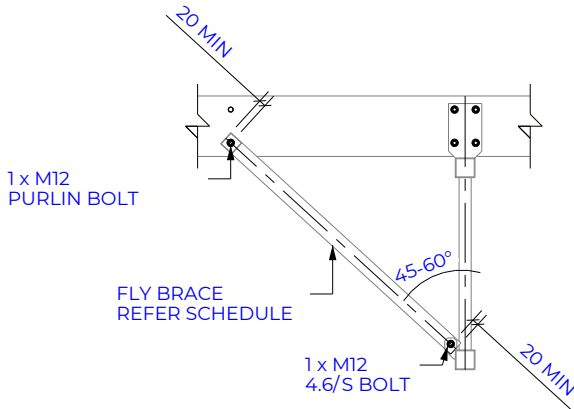


ROOF FLY BRACE DETAIL

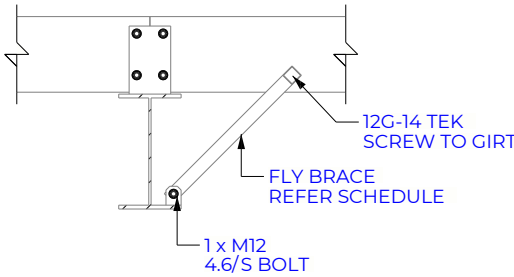


WALL FLY BRACE DETAIL

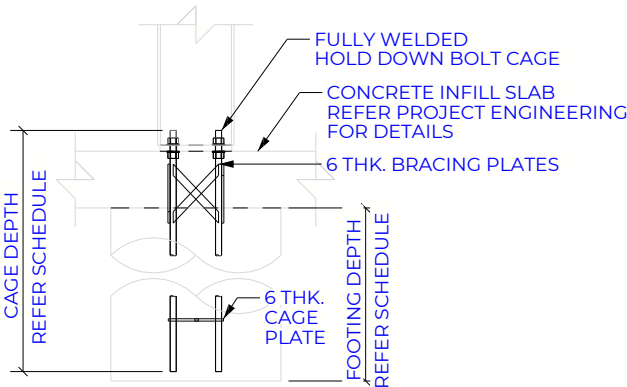


BASE AND CAGE WITH SLAB DETAIL

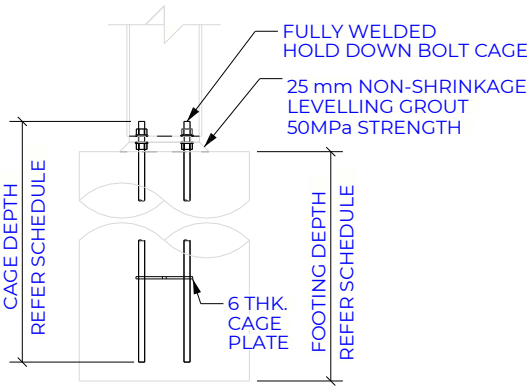


BASE AND CAGE WITHOUT SLAB DETAIL

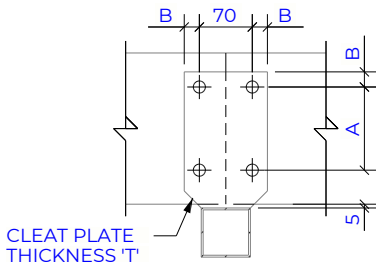


DOUBLE PURLIN CLEAT DETAIL

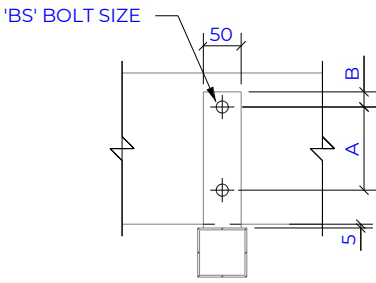

SINGLE PURLIN CLEAT DETAIL

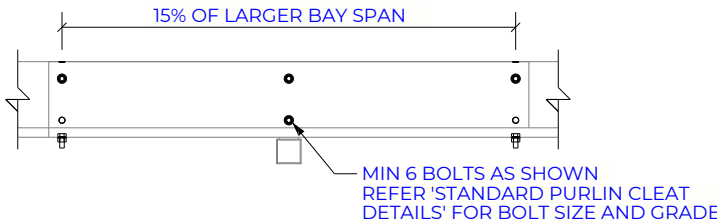


Z PURLIN LAP DETAIL

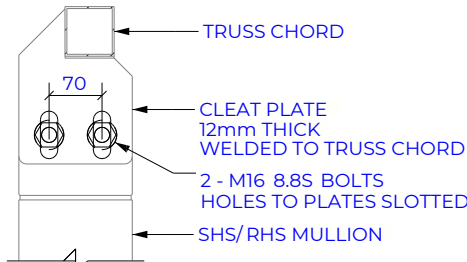


RHS/SHS MULLION TO TRUSS

STANDARD PURLIN CLEAT DETAILS				
PURLIN DEPTH	'T' PLATE THICKNESS	'A' BOLT HOLE CENTRES	'B' EDGE DIST. MINIMUM	'BS' BOLT SIZE
100	6	40	1.5 x 'BS'	M12
150	6	70	1.5 x 'BS'	M12
200	6	110	1.5 x 'BS'	M12
250	8	160	1.5 x 'BS'	M12
300	8	210	1.5 x 'BS'	M16
350	8	260	1.5 x 'BS'	M16
400	8	310	1.5 x 'BS'	M16
1. SINGLE CLEAT TO BE A MINIMUM OF 8mm FOR ALL PURLIN SIZES 2. SEE SUPPLIER DOCUMENTATION FOR BOLT GRADE REQUIREMENTS				

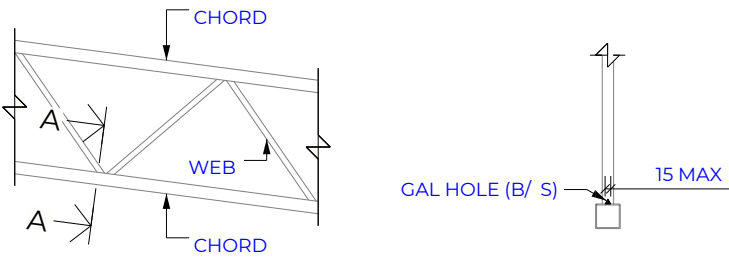

TRUSS WEB GAL HOLE DETAIL

SECTION A-A

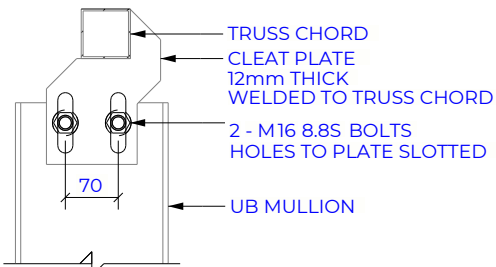









UB MULLION TO TRUSS

PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

STANDARD STEEL DETAILS 2 JOB 21064 SHEET S4.02 REV A

THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER	REV	DESCRIPTION	DATE	DRAWN
SIZE A3 SCALE 1:1 PAGE 11 OF 14	A	PRELIMINARY	05/05/2025	AK



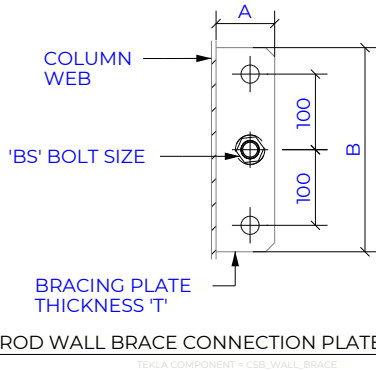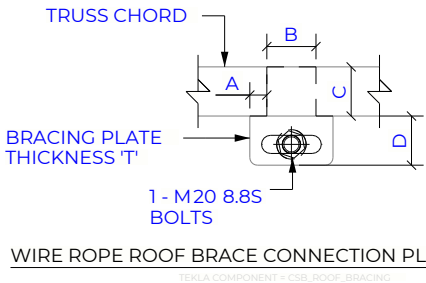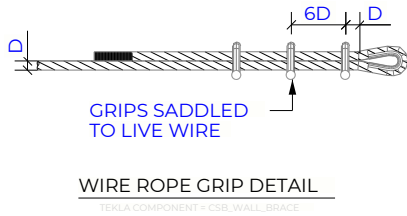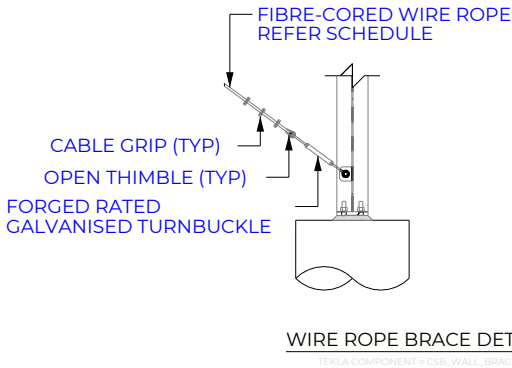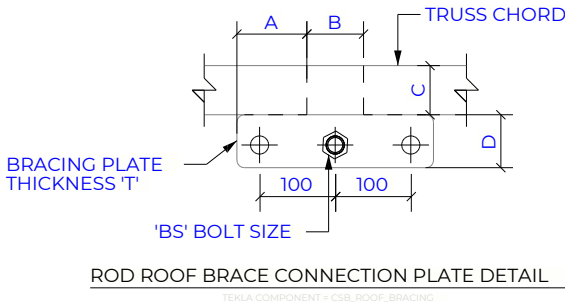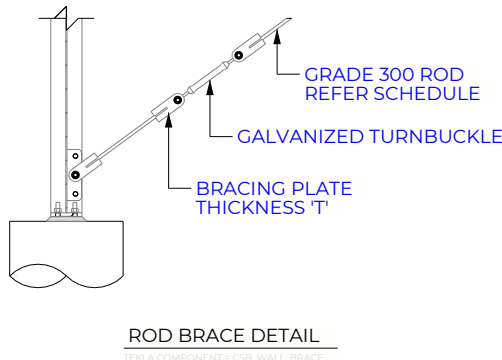
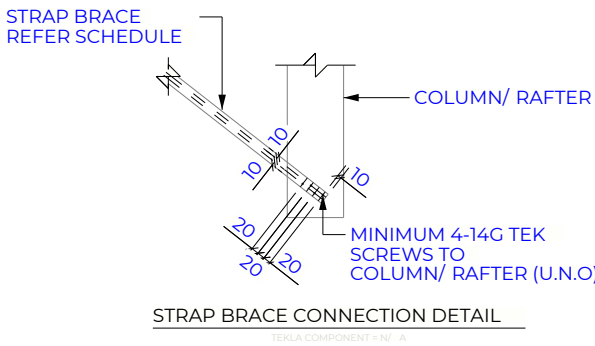


WIRE ROPE AND BRACE CLEAT DETAILS								
ROPE DIA	TURNBUCKLE SIZE FORGE-RATED	MIN NO. OF GRIPS	TIGHTENING TORQUE (N.m)	CLEAT DIMENSIONS				'T' PLATE THICKNESS
				'A'	'B'	'C'	'D'	
8	M16	3	6	30	50	50	65	12
10	M16	3	16	30	50	50	65	12
12	M16	3	24	30	50	50	65	12
14	M16	4	35	5	100	75	65	12
16	M20	4	50	5	100	75	65	12
1. DIMENSION 'C' TO BE A MINIMUM OF CHORD WIDTH OR LISTED VALUE, WHICHEVER IS GREATER 2. DIMENSION 'B' TO BE EQUAL TO OR LARGER THAN DIMENSION 'C' 3. 16 DIA ROPE REQUIRES M24 8.8S BOLT CONNECTIONS								

ROD WALL BRACE CLEAT DETAILS							
ROD DIA	TURNBUCKLE SIZE	CLEAT DIMENSIONS				'T' PLATE THICKNESS	'BS' BOLT SIZE
		'A'	'B'	'C'	'D'		
16	M16	70	260	-	-	12	M16 8.8S
20	M20	82	272	-	-	16	M20 8.8S
24	M22	82	272	-	-	20	M24 8.8S
30	M28	100	290	-	-	25	M30 8.8S



PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

STANDARD STEEL DETAILS 3		JOB 21064		SHEET S4.03		REV A	
THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER		REV	DESCRIPTION	DATE	DRAWN	<div><div></div><div>Central</div><div>Steel build</div></div>	
SIZE A3 SCALE 1:1 PAGE 12 OF 14		A	PRELIMINARY	05/05/2025	AK		

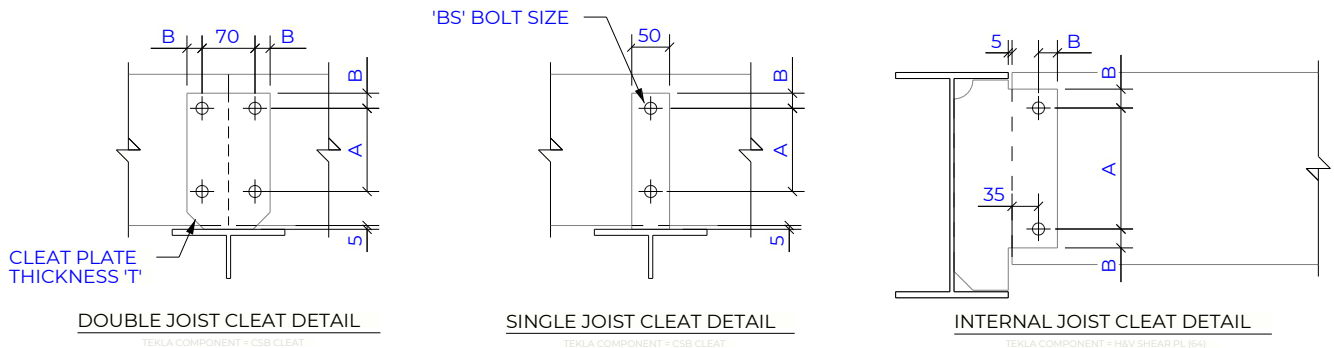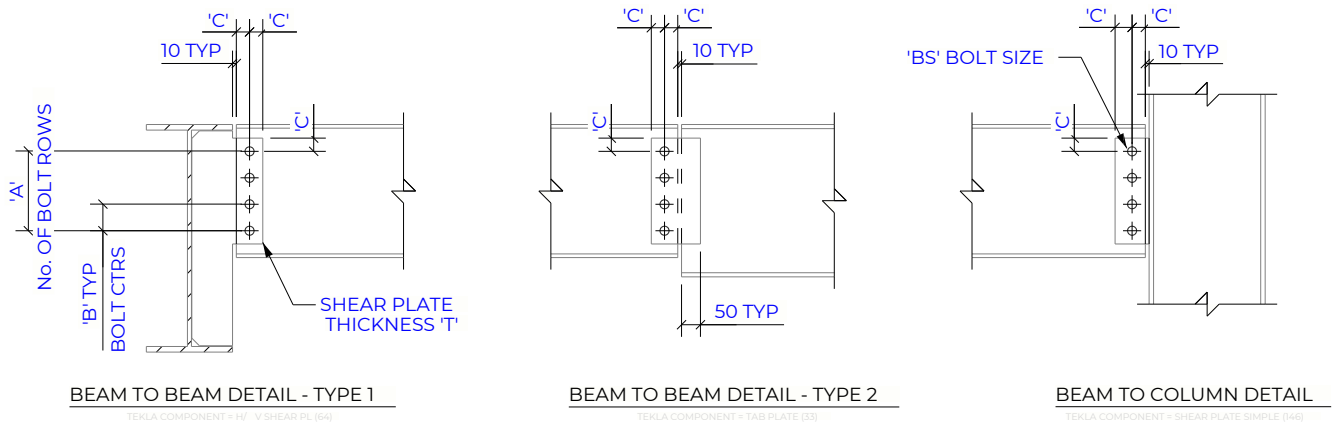

STANDARD SHEAR PLATE CONNECTION DETAILS - UB & PFC BEAMS							
MEMBER SIZE		'A' # OF BOLT ROWS	'B' BOLT HOLE CENTRES	'C' EDGE DIST. MINIMUM	'BS' BOLT SIZE	'T' PLATE THICKNESS	'W' WELD SIZE
UB	PFC						
150UB	150PFC	2	50	1.5 x 'BS'	M12 8.8S	10	6 CFW
180UB	180 PFC	2	70	1.5 x 'BS'	M16 8.8S	12	6 CFW
200UB	200PFC 230PFC	2	70	1.5 x 'BS'	M16 8.8S	12	6 CFW
250UB	250PFC	3	70	1.5 x 'BS'	M16 8.8S	12	6 CFW
310UB	300PFC	3	70	1.5 x 'BS'	M20 8.8S	12	6 CFW
360UB	380PFC	4	70	1.5 x 'BS'	M20 8.8S	16	6 CFW
410UB	-	4	70	1.5 x 'BS'	M20 8.8S	16	6 CFW
460UB	-	5	70	1.5 x 'BS'	M20 8.8S	16	6 CFW
530UB	-	6	70	1.5 x 'BS'	M20 8.8S	16	6 CFW
610UB	-	7	70	1.5 x 'BS'	M20 8.8S	16	6 CFW

STANDARD JOIST CLEAT DETAILS				
JOIST DEPTH	'T' PLATE THICKNESS	'A' BOLT HOLE CENTRES	'B' EDGE DIST. MINIMUM	'BS' BOLT SIZE
100	6	40	1.5 x 'BS'	M12 8.8S
150	6	70	1.5 x 'BS'	M12 8.8S
200	6	110	1.5 x 'BS'	M12 8.8S
250	8	160	1.5 x 'BS'	M12 8.8S
300	8	210	1.5 x 'BS'	M16 8.8S
350	8	260	1.5 x 'BS'	M16 8.8S
400	8	310	1.5 x 'BS'	M16 8.8S
1. SINGLE CLEAT TO BE A MINIMUM OF 8mm THICK FOR ALL PURLIN SIZES				

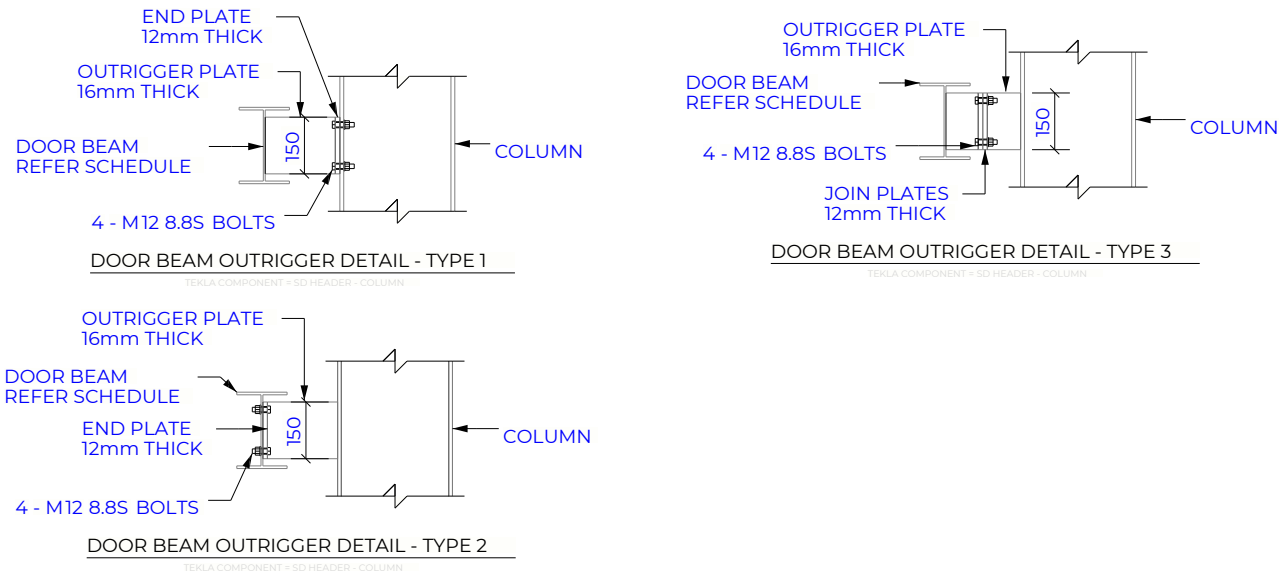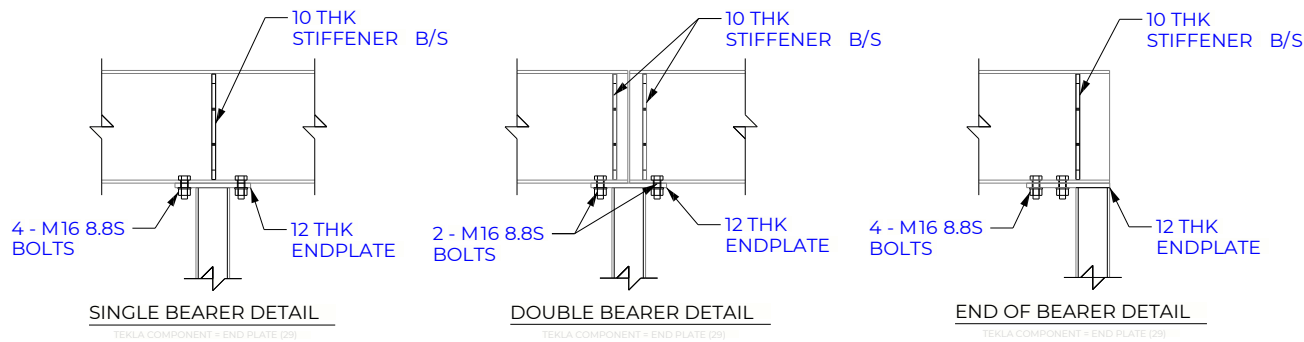

PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

STANDARD STEEL DETAILS 4

JOB 21064

SHEET S4.04

REV A

THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER

REV	DESCRIPTION	DATE	DRAWN


SIZE A3 SCALE 1:1 PAGE 13 OF 14

A	PRELIMINARY	05/05/2025	AK
---	-------------	------------	----


CONCRETE PANEL NOTES

ALL PANELS ARE TO BE 150mm THICK UNLESS NOTED OTHERWISE.
REINFORCEMENT OF PANELS AS SHOWN ON TYPICAL PANEL ELEVATIONS.
PANELS MUST NOT BE LIFTED UNTIL A CONCRETE STRENGTH OF 32MPa HAS BEEN ACHIEVED. (CONCRETE STRENGTH USED 40 MPa, SLUMP 60mm).
THE CASTING BED IS TO BE COATED WITH AN APPROVED BOND BREAKER TO LIMIT ANY SUCTION WHEN LIFTED.
THE CRANE USED FOR LIFTING PANELS IS TO HAVE A MINIMUM CAPACITY OF 3 TIMES THE WEIGHT OF PANEL BEING LIFTED.
ALL PANELS TO BE POSITIONED ON "KOROLATH" SHIMPAKS (OR SIMILAR APPROVED) AT EACH END OF PANELS.
ON SITE THE CRANE IS TO HOLD THE PANELS UNTIL SHIMPAKS AND ALL FIXINGS ARE IN POSITION, INCLUDING TEMPORARY PROPS.
FOR FILLING AND OR FIRE RATING OF ALL GAPS AND FIRE RATING OF PANEL FIXINGS (NOT CONC. ENCASED) REFER DETAILS.
THE PANEL MANUFACTURER IS TO ALLOW FOR SHRINKAGE OF PANELS TO ACHIEVE DIMENSIONS REQUIRED BY ARCHITECT.
ALL PANEL FIXINGS ARE TO BE HOT DIPPED GALVANISED EXCEPT WHERE WELDING IS REQUIRED. THESE FIXINGS ARE TO BE COATED WITH AN APPROVED PAINT ON SITE.
THE PANEL MANUFACTURER IS TO PROVIDE THE ENGINEER WITH THE TYPE OF ALL LIFTING AND FIXING EQUIPMENT FOR APPROVAL.
BOTH THE STEEL AND PANEL DETAILERS ARE TO WORK IN CONJUNCTION WITH EACH OTHER TO DETERMINE BLOCKOUT SITES ETC.
THE BUILDER IS TO SYNCHRONIZE THE ERECTION OF BOTH THE PANELS AND STEELWORK ON BOUNDARIES OR WHERE CRANE ACCESS IS LIMITED AND INFORM THE ENGINEER OF PROPOSED ERECTION SEQUENCE.
PRECAST MANUFACTURER TO PROVIDE TWO SETS OF FULLY DETAILED SHOP DRAWINGS OF ALL PANELS, INSERTS, FIXINGS, ANCHORS, BOLTS, FERRULES, PENETRATIONS, LIFTING DEVICES ETC. TO ENGINEER FOR APPROVAL.
STRUCTURAL DESIGN : THE CONSULTING ENGINEER HAS DESIGNED THE PRECAST UNITS FOR IN-SERVICE CONDITIONS ONLY. (IE LOADS THE PRECAST PANELS ARE SUBJECTED TO AFTER ERECTION ON SITE).
THE PRECAST MANUFACTURER IS TO PROVIDE COMPUTATIONS FOR APPROVAL FOR STRESSES DUE TO REMOVAL FROM MOULD, HANDLING, LIFTING, TRANSPORTATION AND ERECTION.


CSB TAKES NO RESPONSIBILITY FOR THE FOLLOWING
- OVERALL SIZE / DIMENSIONS OF PRECAST PANELS
- PENETRATION LOCATIONS
- FERRULE LOCATIONS
- CAST IN PLATE LOCATIONS
- LIFTING DEVICES
- ANY OTHER FIXINGS / INSERTS
PRECAST PANELS SHOWN ON THIS SET OF DRAWINGS ARE INDICATIVE ONLY.
IT IS THE PANEL MANUFACTURER'S RESPONSIBILT Y TO ENSURE PANELS CONFORM TO BOTH STRUCTURAL AND ARCHITECTURAL DESIGN REQUIREMENTS.

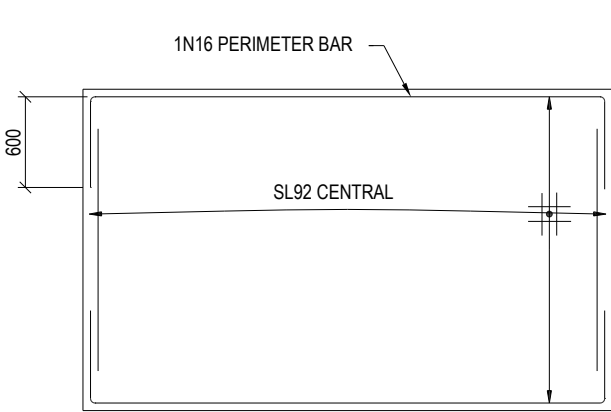


TYPICAL 150 THK PANEL
N.T.S

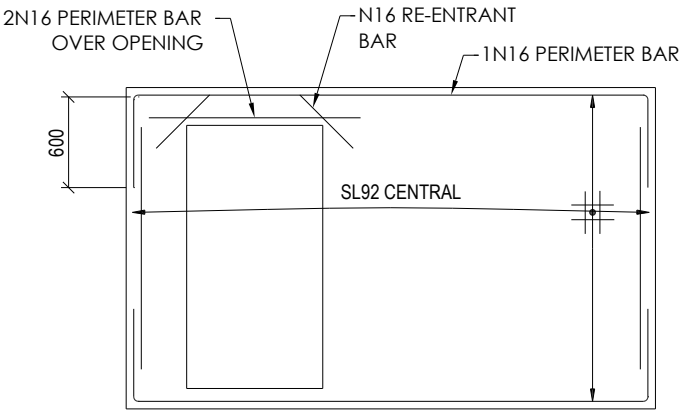


TYPICAL 150 THK PANEL
WITH DOOR OPENING
N.T.S

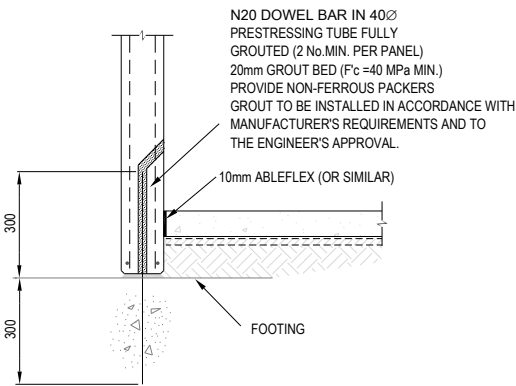


TYPICAL PRECAST WALL - FOOTING DETAIL
N.T.S

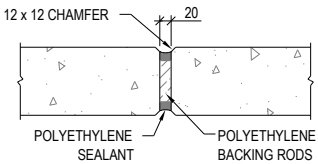


TYPICAL PANEL JOINT DETAIL
N.T.S

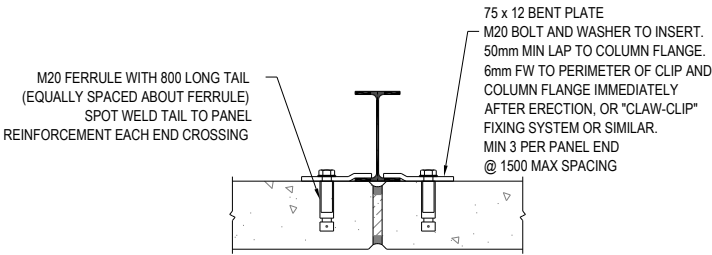


TYPICAL PANEL TO COLUMN DETAIL
N.T.S

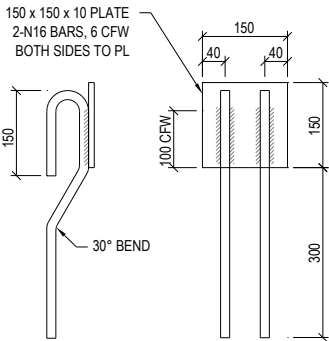

TYPICAL CAST IN PLATE DETAIL
N.T.S

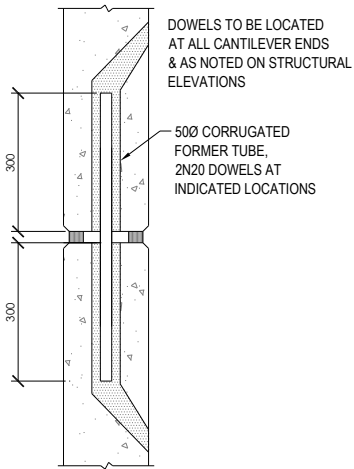

TYPICAL PANEL TO PANEL DOWEL
CONNECTION DETAIL
N.T.S

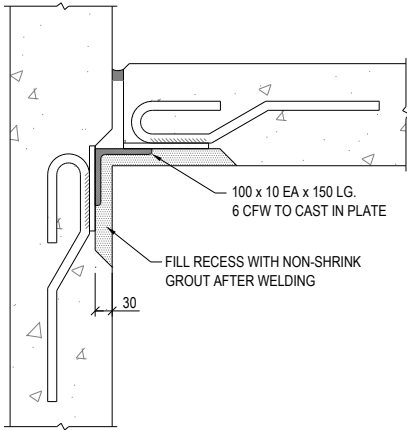

TYPICAL PANEL TO PANEL DETAIL
N.T.S

PROPOSED WAREHOUSE 11
FOR GLENN BRAGANZA
20 PLATINUM COURT THURGOONA, NSW 2640

TYPICAL PANEL DETAILS

JOB 21064

SHEET S5.01

REV A

THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH STRUCTURAL COMPUTATIONS SUPPLIED BY LAKER

REV	DESCRIPTION	DATE	DRAWN
A	PRELIMINARY	05/05/2025	AK

