


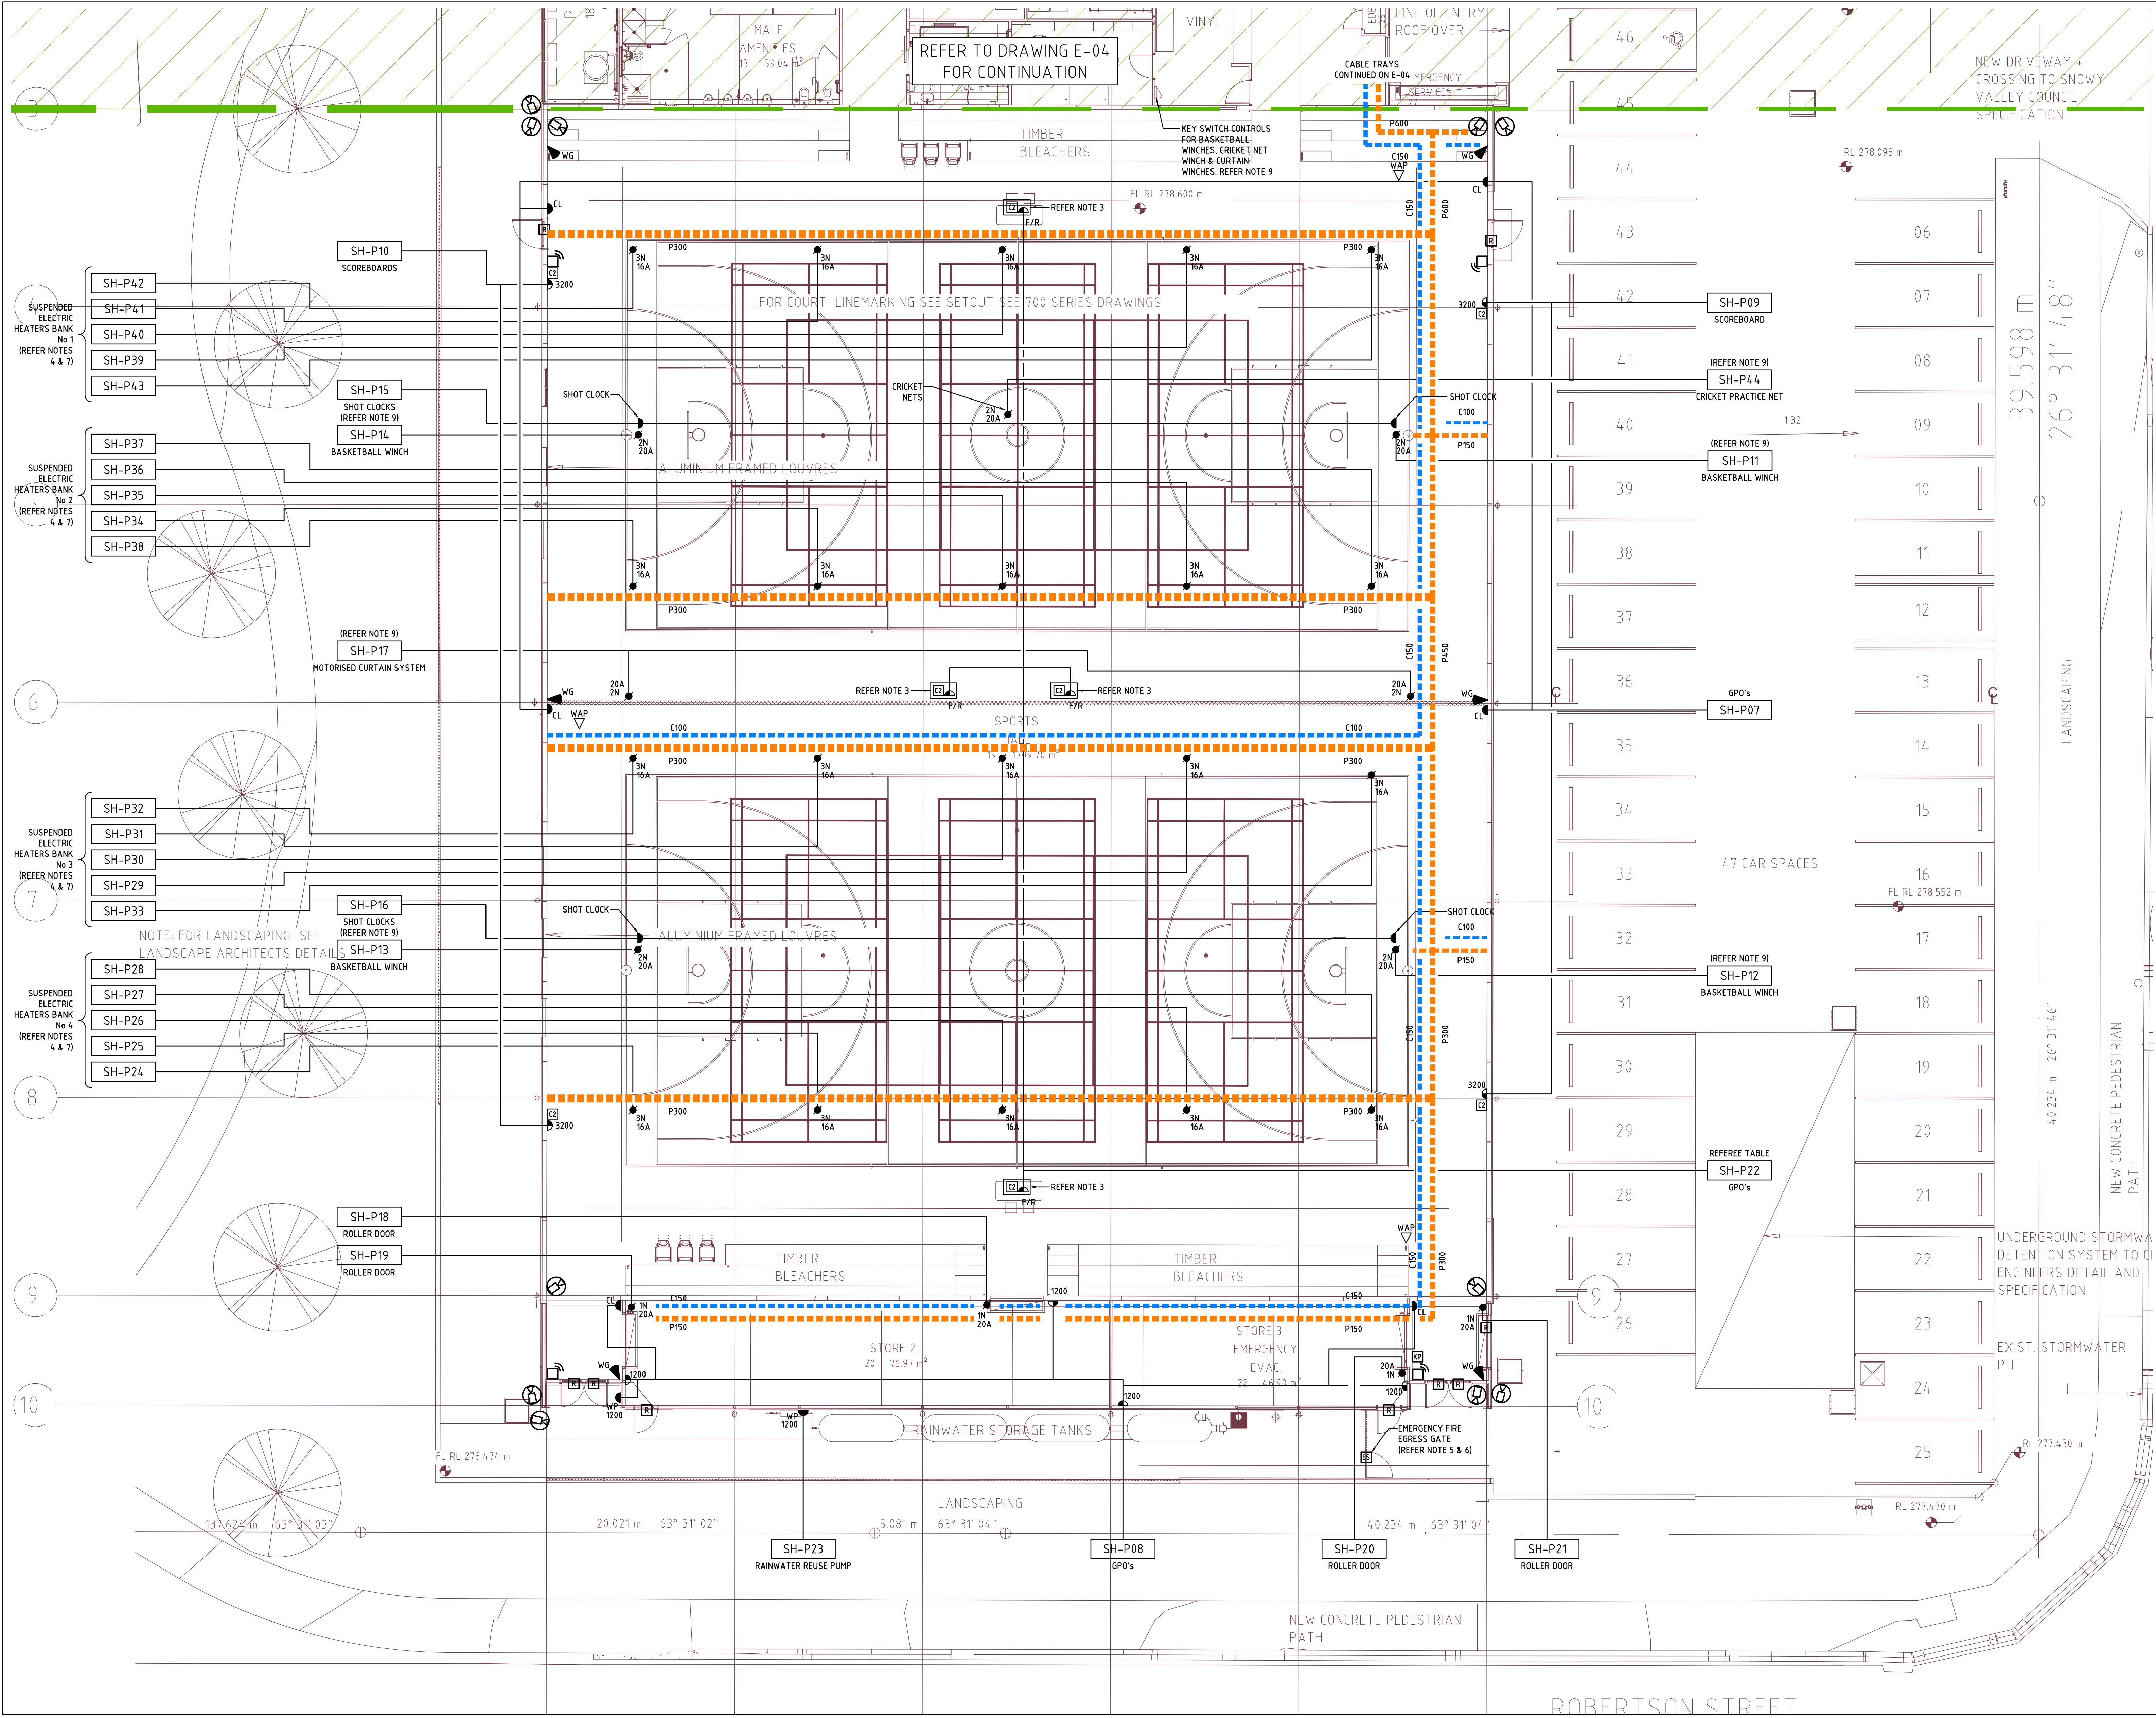

CONTRACTORS MUST VERIFY ALL DIMENSIONS ON SITE BEFORE COMMENCING ANY WORK OR PREPARING SHOP DRAWINGS

All Architectural drawing sheets to be cross-referenced with other relevant disciplines.

Rev	Description	Date
A	ISSUE FOR COORDINATION	28.02.25
B	ISSUE FOR TENDER	23.04.25
C	TENDER ISSUE	05.06.25

NOTES:

- THE CONTRACTOR SHALL NOTE THAT THE USE OF SURFACE CONDUIT & DUCTING SHALL NOT BE PERMITTED WITHOUT PRIOR APPROVAL OF THE SUPERINTENDENT. ALL CABLING RUNS SHALL BE HIDDEN, INTEGRATED INTO BUILDING STRUCTURE OR INSTALLED ON CABLE TRAY UNLESS APPROVED OTHERWISE.
- CABLE TRAYS SHALL BE HEAVY GALVANISED STEEL AND PROVIDED WITH WHITE POWDERCOAT FINISH IN ALL VISIBLE AREAS OF THE BUILDING.
- EXACT SET OUT LOCATION OF FLOOR RECESSED SERVICES BOXES SHALL BE APPROVED BY SUPERINTENDENT PRIOR TO POURING FLOOR SLABS.
- SUSPENDED ELECTRIC HEATERS SHALL BE SUPPLIED AND INSTALLED UNDER MECHANICAL TRADE PACKAGE. WIRING TO ALL ELECTRIC HEATERS IN SPORTS HALL SHALL BE PROVIDED UNDER THE ELECTRICAL TRADE PACKAGE.
- THE CONTRACTOR SHALL PROVIDE FIRE TRIP SIGNAL FROM FIP TO EACH A/C UNIT & MECHANICAL CONTROL PANEL TO ALLOW SHUTDOWN OF ALL A/C UNITS IN FIRE ALARM.
- PROVIDE FIRE TRIP SIGNAL FROM FIP TO ALL ACCESS CONTROLLED DOORS, AUTODOORS & EXTERNAL GATE MAGNETIC LOCKS TO ALLOW AUTOMATIC OPENING ON GENERAL FIRE ALARM.
- ELECTRIC HEATERS SHALL BE PROVIDED WITH MOUNTING BRACKETS (BY HEATER INSTALLER) TO ACHIEVE MINIMUM 600mm SEPARATION BETWEEN THE HEATER & THE SUPPORT CABLE TRAY STRUCTURE TO MINIMISE HEATING AFFECTS TO ELECTRICAL CABLING
- REFER TO DRAWING E-05 FOR FURTHER CABLE TRAY MOUNTING DETAILS
- PROVIDE 4WIRE POWER CABLING (ie. A1, A2, N, E) TO ALL BASKET BALL BACKBOARD WINCHES, CRICKET NETS WINCH, & CURTAIN WINCHES TO ALLOW FOR REVERSIBLE MOTOR OPERATION. REFER TO DRAWING E-303 FOR FURTHER SCHEMATIC DETAILS

CONSULTANT 1:

SPECTRUM
ENGINEERING SOLUTIONS
1 Davis Place
Glenhaven NSW 2156
Phone: (02) 8650 4802
Mobile: 0411 514 533
Email: nat@spectrumdesign.com.au

NEW Reg. No. 7148
ABN: 75 503 974 624
E: info@tdg.com.au
W: www.tdg.com.au
P: 02 4446 0777
PO Box 65
Cammeray NSW 2060

CUSTOMER:

SNOWY VALLEYS COUNCIL

PROJECT NAME:

MULTI PURPOSE PLUS EVACUATION CENTRE

PROJECT ADDRESS:

Lot 1, Section 81 DP 759004 & Lot 701 DP 1059193
RICHMOND PARK, TUMUT NSW

DRAWING TITLE: ELECTRICAL SERVICES

POWER, SECURITY & COMMUNICATIONS SERVICES LAYOUTS SHEET No. 1 B1 PRINT SIZE

SHEET ISSUE DATE:	24.02.2025	DRAWING NO.	REV.
REVISION DATE:			
SCALE:	1:100 @ B1	E-03	C
JOB NO.:	22-076		
DRAWN BY: JDC	CHECKED BY: NC		